




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. W-J-3050

WJ 3050

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating — 4 Hr	F Rating — 4 Hr
T Rating — 1 Hr	FT Rating — 1 Hr
	FH Rating — 4 Hr
	FTH Rating — 1 Hr

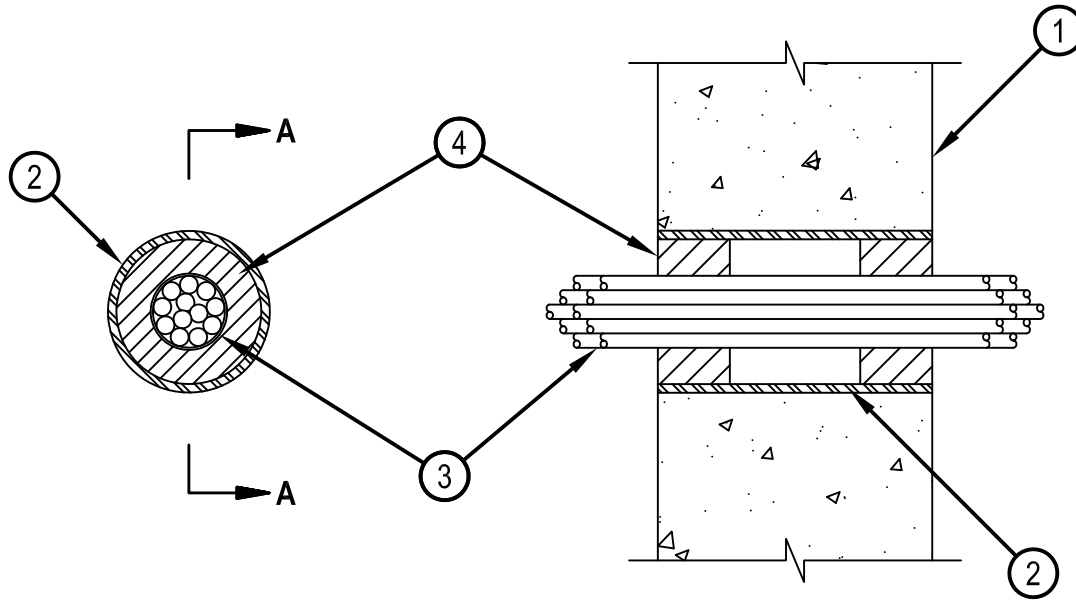

SECTION A-A

1. Wall Assembly — Min 7-1/2 in. (191 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Max diam of opening is 4 in. (102 mm).
See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.
2. Steel Sleeve — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 (or heavier) steel pipe sleeve friction fit in nom 4 in. (102 mm) diam circular opening core drilled through wall. Length of steel sleeve to be equal to thickness of wall.
3. Cables — Aggregate cross sectional area of cables in opening to be max 33 percent of the cross sectional area of the opening. Cables installed either concentrically or eccentrically within the firestop system. The annular space between cables and the steel sleeve shall be min 1/4 in. (6 mm) to max 1 in. (25 mm). Cables to be rigidly supported on both sides of wall assembly. The following types and sizes of cables may be used:
 - A. 7/C (with ground) No. 12 AWG cable, with PVC insulation and outer jacket.
 - B. Max 25 pair No. 24 AWG (or smaller) copper conductor telephone cable with PVC insulation, with PVC jacket.
 - C. Max RG59/U (or smaller) coaxial cable with fluorinated ethylene insulation and jacketing.
 - D. 3/C (with ground) No. 10 AWG bare copper ground metal clad cable with a PVC jacket.
 - E. Multiple 24 fiber-optical communication cables jacketed with polyvinyl chloride and having a max outside diam of 1/2 in. (13 mm).
4. Fill, Void or Cavity Material*—Sealant — Min 2 in. (51 mm) thickness of fill material applied within annulus, flush with both surfaces of the wall.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
January 22, 2015