

**DIVISION: 03 00 00—CONCRETE**  
**Section: 03 16 00—Concrete Anchors**

**DIVISION: 05 00 00—METALS**  
**Section: 05 05 19—Post-Installed Concrete Anchors**

## REPORT HOLDER:

HILTI, INC.

## EVALUATION SUBJECT:

**HILTI KWIK BOLT TZ2 CARBON AND STAINLESS  
 STEEL ANCHORS IN CRACKED AND UNCRACKED  
 CONCRETE**

## 1.0 EVALUATION SCOPE

### Compliance with the following codes:

- 2021, 2018, 2015, and 2012 *International Building Code*® (IBC)
- 2021, 2018, 2015, and 2012 *International Residential Code*® (IRC)

For evaluation for compliance with the *National Building Code of Canada*® (NBCC), see listing report [ELC-4266](#).

For evaluation for compliance with codes adopted by the Los Angeles Department of Building and Safety (LADBS), see [ESR-4266 LABC and LARC Supplement](#).

### Property evaluated:

Structural

## 2.0 USES

The Hilti Kwik Bolt TZ2 anchor (KB-TZ2) is used as anchorage to resist static, wind, and seismic (Seismic Design Categories A through F) tension and shear loads in cracked and uncracked normal-weight concrete and lightweight concrete having a specified compressive strength,  $f'_c$ , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa).

The 1/4-inch-, 3/8-inch- and 1/2-inch diameter (6.4 mm, 9.5 mm and 12.7 mm) carbon steel KB-TZ2 anchors may be installed in the topside of cracked and uncracked normal-weight or sand-lightweight concrete over metal deck having a minimum member thickness,  $h_{min,deck}$ , as noted in Table 9 of this evaluation report and a specified compressive strength,  $f'_c$ , of 3,000 psi to 8,500 psi (20.7 MPa to 58.6 MPa).

The 1/4-inch-, 3/8-inch-, 1/2-inch-, 5/8-inch- and 3/4-inch diameter (6.4 mm, 9.5 mm, 12.7 mm, 15.9 mm and 19.1 mm) carbon steel KB-TZ2 anchors may be installed in the

soffit of cracked and uncracked normal-weight or sand-lightweight concrete over metal deck having a minimum specified compressive strength,  $f'_c$ , of 3,000 psi (20.7 MPa).

The anchoring system complies with anchors as described in Section 1901.3 of the 2021, 2018 and 2015 IBC, and Section 1909 of the 2012 IBC. The anchoring system is an alternative to cast-in-place anchors described in Section 1908 of the 2012 IBC. The anchors may also be used where an engineered design is submitted in accordance with Section R301.1.3 of the IRC.

## 3.0 DESCRIPTION

### 3.1 KB-TZ2:

KB-TZ2 anchors are torque-controlled, mechanical expansion anchors. KB-TZ2 anchors consist of a stud (anchor body), wedge (expansion elements), nut, and washer. The anchor (carbon steel version) is illustrated in Figure 1. The stud is manufactured from carbon steel or AISI Type 304 or Type 316 stainless steel materials. Carbon steel KB-TZ2 anchors have a minimum 5  $\mu$ m (0.0002 inch) zinc-nickel plating. The expansion elements for the carbon steel KB-TZ2 anchors are fabricated from carbon steel. The expansion elements for the stainless steel KB-TZ2 anchors are fabricated from stainless steel. The hex nut for carbon steel conforms to ASTM A563-04, Grade A, and the hex nut for stainless steel conforms to ASTM F594.

The anchor body is comprised of a high-strength rod threaded at one end and a tapered mandrel at the other end. The tapered mandrel is enclosed by a three-section expansion element. The expansion element movement is restrained by the mandrel taper and by a collar. The anchor is installed in a predrilled hole with a hammer. When torque is applied to the nut of the installed anchor, the mandrel is drawn into the expansion element, which is in turn expanded against the wall of the drilled hole.

### 3.2 Concrete:

Normal-weight and lightweight concrete must conform to Sections 1903 and 1905 of the IBC.

### 3.3 Steel Deck Panels:

Steel deck panels must be in accordance with the configuration in Figure 5A, Figure 5B, Figure 5C and Figure 5D and have a minimum base steel thickness of 0.035 inch (0.899 mm, 20 gauge). Steel must comply with ASTM A653/A653M SS Grade 55 and have a minimum yield strength of 55,000 psi (379 MPa).

## 4.0 DESIGN AND INSTALLATION

### 4.1 Strength Design:

**4.1.1 General:** Design strength of anchors complying with the 2021 IBC, as well as Section R301.1.3 of the 2021 IRC

must be determined in accordance with ACI 318-19 Chapter 17 and this report.

Design strength of anchors complying with the 2018 and 2015 IBC, as well as Section R301.1.3 of the 2018 and 2015 IRC must be determined in accordance with ACI 318-14 Chapter 17 and this report.

Design strength of anchors complying with the 2012 IBC as well as Section R301.1.3 of the 2012 IRC, must be determined in accordance with ACI 318-11 Appendix D and this report.

Design parameters provided in Table 4, Table 5, Table 6 and Table 7 of this report are based on the 2021 IBC (ACI 318-19), 2018 and 2015 IBC (ACI 318-14) and the 2012 IBC (ACI 318-11) unless noted otherwise in Sections 4.1.1 through 4.1.12. The strength design of anchors must comply with ACI 318-19 17.5.1.2, ACI 318-14 17.3.1 or ACI 318-11 D.4.1, as applicable, except as required in ACI 318-19 17.10, ACI 318-14 17.2.3 or ACI 318-11 D.3.3, as applicable.

Strength reduction factors,  $\phi$ , as given in ACI 318-19 17.5.3, ACI 318-14 17.3.3 or ACI 318-11 D.4.3, as applicable, and noted in Table 4, Table 5, Table 6, and Table 7 of this report, must be used for load combinations calculated in accordance with Section 1605.1 of the 2021 IBC or Section 1605.2 of the 2018, 2015 and 2012 IBC and Section 5.3 of ACI 318 (-19 and -14) or Section 9.2 of ACI 318-11, as applicable. Strength reduction factors,  $\phi$ , as given in ACI 318-11 D.4.4 must be used for load combinations calculated in accordance with ACI 318-11 Appendix C. The value of  $f'_c$  used in the calculations must be limited to a maximum of 8,000 psi (55.2 MPa), in accordance with ACI 318-19 17.3.1, ACI 318-14 17.2.7 or ACI 318-11 D.3.7, as applicable.

**4.1.2 Requirements for Static Steel Strength in Tension:** The nominal static steel strength,  $N_{sa}$ , of a single anchor in tension must be calculated in accordance with ACI 318-19 17.6.1.2, ACI 318-14 17.4.1.2 or ACI 318-11 D.5.1.2, as applicable. The resulting  $N_{sa}$  values are provided in Table 4 and Table 5 of this report. Strength reduction factors  $\phi$  corresponding to ductile steel elements may be used.

**4.1.3 Requirements for Static Concrete Breakout Strength in Tension:** The nominal concrete breakout strength of a single anchor or group of anchors in tension,  $N_{cb}$  or  $N_{cbg}$ , respectively, must be calculated in accordance with ACI 318-19 17.6.2, ACI 318-14 17.4.2 or ACI 318-11 D.5.2, as applicable, with modifications as described in this section. The basic concrete breakout strength in tension,  $N_b$ , must be calculated in accordance with ACI 318-19 17.6.2.2, ACI 318-14 17.4.2.2 or ACI 318-11 D.5.2.2, as applicable, using the values of  $h_{ef}$  and  $k_{cr}$  as given in Table 4 and Table 5. The nominal concrete breakout strength in tension in regions where analysis indicates no cracking in accordance with ACI 318-19 17.6.2.5.1, ACI 318-14 17.4.2.6 or ACI 318-11 D.5.2.6, as applicable, must be calculated with  $k_{uncr}$  as given in Table 4 and Table 5 and with  $\Psi_{c,N} = 1.0$ .

For carbon steel KB-TZ2 anchors installed in the soffit of sand-lightweight or normal-weight concrete on steel deck floor and roof assemblies, as shown in Figure 5A, Figure 5B and Figure 5C, calculation of the concrete breakout strength is not required.

**4.1.4 Requirements for Static Pullout Strength in Tension:** The nominal pullout strength of a single anchor in accordance with ACI 318-19 17.6.3.1 and 17.6.3.2.1, ACI 318-14 17.4.3.1 and 17.4.3.2 or ACI 318-11 D.5.3.1 and D.5.3.2, respectively, as applicable, in cracked and uncracked concrete,  $N_{p,cr}$  and  $n_{cr}$ ,  $N_{p,uncr}$  and  $n_{uncr}$ ,

respectively, are given in Table 4 and Table 5. For all design cases  $\Psi_{c,P} = 1.0$ . In accordance with ACI 318-19 17.6.3, ACI 318-14 17.4.3 or ACI 318-11 D.5.3, as applicable, the nominal pullout strength in cracked concrete may be calculated in accordance with the following equation:

$$N_{p,f'_c} = N_{p,cr} \left( \frac{f'_c}{2,500} \right)^{n_{cr}} \quad (\text{lb, psi}) \quad (\text{Eq-1})$$

$$N_{p,f'_c} = N_{p,cr} \left( \frac{f'_c}{17.2} \right)^{n_{cr}} \quad (\text{N, MPa})$$

In regions where analysis indicates no cracking in accordance with ACI 318-19 17.6.3.3, ACI 318-14 17.4.3.6 or ACI 318-11 D.5.3.6, as applicable, the nominal pullout strength in tension may be calculated in accordance with the following equation:

$$N_{p,f'_c} = N_{p,uncr} \left( \frac{f'_c}{2,500} \right)^{n_{uncr}} \quad (\text{lb, psi}) \quad (\text{Eq-2})$$

$$N_{p,f'_c} = N_{p,uncr} \left( \frac{f'_c}{17.2} \right)^{n_{uncr}} \quad (\text{N, MPa})$$

Where values for  $N_{p,cr}$  or  $N_{p,uncr}$  are not provided in Table 4 or Table 5, the pullout strength in tension need not be evaluated.

The nominal pullout strength in cracked concrete of the carbon steel KB-TZ2 installed in the soffit of sand-lightweight or normal-weight concrete on steel deck floor and roof assemblies, as shown in Figure 5A, Figure 5B and Figure 5C, is given in Table 8. In accordance with ACI 318-19 17.6.3.2.1, ACI 318-14 17.4.3.2 or ACI 318-11 D.5.3.2, as applicable, the nominal pullout strength in cracked concrete must be calculated in accordance with Eq-1, whereby the value of  $N_{p,deck,cr}$  must be substituted for  $N_{p,cr}$  and the value of 3,000 psi (20.7 MPa) must be substituted for the value of 2,500 psi (17.2 MPa) in the denominator. In regions where analysis indicates no cracking in accordance with ACI 318-19 17.6.3.3, ACI 318-14 17.4.3.6 or ACI 318-11 D.5.3.6, as applicable, the nominal strength in uncracked concrete must be calculated according to Eq-2, whereby the value of  $N_{p,deck,uncr}$  must be substituted for  $N_{p,uncr}$  and the value of 3,000 psi (20.7 MPa) must be substituted for the value of 2,500 psi (17.2 MPa) in the denominator. The use of stainless steel KB-TZ2 anchors installed in the soffit of concrete on steel deck assemblies is beyond the scope of this report.

**4.1.5 Requirements for Static Steel Strength in Shear:** The nominal steel strength in shear,  $V_{sa}$ , of a single anchor in accordance with ACI 318-19 17.7.1.2, ACI 318-14 17.5.1.2 or ACI 318-11 D.6.1.2, as applicable, is given in Table 6 and Table 7 of this report and must be used in lieu of the values derived by calculation from ACI 318-19 Eq. 17.7.1.2b, ACI 318-14 Eq. 17.5.1.2b or ACI 318-11 Eq. D-29, as applicable. The shear strength  $V_{sa,deck}$  of the carbon-steel KB-TZ2 as governed by steel failure of the KB-TZ2 installed in the soffit of sand-lightweight or normal-weight concrete on steel deck floor and roof assemblies, as shown in Figure 5A, Figure 5B and Figure 5C, is given in Table 8.

**4.1.6 Requirements for Static Concrete Breakout Strength in Shear:** The nominal concrete breakout strength of a single anchor or group of anchors in shear,  $V_{cb}$  or  $V_{cbg}$ , respectively, must be calculated in accordance with ACI 318-19 17.7.2, ACI 318-14 17.5.2 or ACI 318-11 D.6.2, as applicable, with modifications as described in this section. The basic concrete breakout strength,  $V_b$ , must be calculated in accordance with ACI 318-19 17.7.2.2.1, ACI 318-14 17.5.2.2 or ACI 318-11 D.6.2.2, as applicable, based on the values provided in Table 6 and Table 7. The value of  $\ell_e$  used in ACI 318-19 Eq. 17.7.2.2.1a, ACI 318-14 Eq. 17.5.2.2a or ACI 318-11 Eq. D-33 must be taken as no

greater than the lesser of  $h_{ef}$  or  $8d_a$ . Anchors installed in light-weight concrete must use the reduction factors provided in ACI 318-19 17.2.4, ACI 318-14 17.2.6 or ACI 318-11 D.3.6, as applicable.

For carbon steel KB-TZ2 anchors installed in the soffit of sand-lightweight or normal-weight concrete on steel deck floor and roof assemblies, as shown in Figure 5A, Figure 5B and Figure 5C, calculation of the concrete breakout strength in shear is not required.

**4.1.7 Requirements for Static Concrete Pryout Strength in Shear:** The nominal concrete pryout strength of a single anchor or group of anchors,  $V_{cp}$  or  $V_{cpg}$ , respectively, must be calculated in accordance with ACI 318-19 17.7.3, ACI 318-14 17.5.3 or ACI 318-11 D.6.3, as applicable, modified by using the value of  $k_{cp}$  provided in Table 6 and Table 7 of this report and the value of  $N_{cb}$  or  $N_{cbg}$  as calculated in Section 4.1.3 of this report.

For carbon steel KB-TZ2 anchors installed in the soffit of sand-lightweight or normal-weight concrete over profile steel deck floor and roof assemblies, as shown in Figure 5A, Figure 5B, and Figure 5C, calculation of the concrete pryout strength in accordance with ACI 318-19 17.7.3, ACI 318-14 17.5.3 or ACI 318-11 D.6.3 is not required.

#### 4.1.8 Requirements for Seismic Design:

**4.1.8.1 General:** For load combinations including seismic, the design must be performed in accordance with ACI 318-19 17.10, ACI 318-14 17.2.3 or ACI 318-11 D.3.3, as applicable. Modifications to ACI 318-14 17.2.3 shall be applied under Section 1905.1.8 of the 2018 and 2015 IBC. For the 2012 IBC, Section 1905.1.9 shall be omitted.

The anchors comply with ACI 318 (-19 and -14) 2.3 or ACI 318-11 D.1, as applicable, as ductile steel elements and must be designed in accordance with ACI 318-19 17.10.5, 17.10.6, 17.10.7 or 17.10.4 ACI 318-14 17.2.3.4, 17.2.3.5, 17.2.3.6 and 17.2.3.7; or ACI 318-11 D.3.3.4, D.3.3.5, D.3.3.6 and D.3.3.7, as applicable. Strength reduction factors,  $\phi$ , are given in Table 4, Table 5, Table 6, and Table 7 of this report. The anchors may be installed in structures assigned to Seismic Design Categories A through F of the IBC.

**4.1.8.2 Seismic Tension:** The nominal steel strength and nominal concrete breakout strength for anchors in tension must be calculated in accordance with ACI 318-19 17.6.1 and 17.6.2, ACI 318-14 17.4.1 and 17.4.2 or ACI 318-11 D.5.1 and D.5.2, as applicable, as described in Sections 4.1.2 and 4.1.3 of this report. In accordance with ACI 318-19 17.6.3.2.1, ACI 318-14 17.4.3.2 or ACI 318-11 D.5.3.2, as applicable, the appropriate pullout strength in tension for seismic loads,  $N_{p,eq}$ , described in Table 4 and Table 5 or  $N_{p,deck,cr}$  described in Table 8 must be used in lieu of  $N_p$ , as applicable. The value of  $N_{p,eq}$  or  $N_{p,deck,cr}$  may be adjusted by calculation for concrete strength in accordance with Eq-1 and Section 4.1.4 whereby the value of  $N_{p,deck,cr}$  must be substituted for  $N_{p,cr}$  and the value of 3,000 psi (20.7 MPa) must be substituted for the value of 2,500 psi (17.2 MPa) in the denominator. If no values for  $N_{p,eq}$  or  $N_{p,deck,eq}$  are given in Table 4, Table 5, or Table 8, the static design strength values govern.

**4.1.8.3 Seismic Shear:** The nominal concrete breakout strength and pryout strength in shear must be calculated in accordance with ACI 318-19 17.7.2 and 17.7.3, ACI 318-14 17.5.2 and 17.5.3 or ACI 318-11 D.6.2 and D.6.3, respectively, as applicable, as described in Sections 4.1.6 and 4.1.7 of this report. In accordance with ACI 318-19 17.7.1.2, ACI 318-14 17.5.1.2 or ACI 318-11 D.6.1.2, as applicable, the appropriate value for nominal steel strength for seismic loads,  $V_{sa,eq}$  described in Table 6 and Table 7 or

$V_{sa,deck,eq}$  described in Table 8 must be used in lieu of  $V_{sa}$ , as applicable.

**4.1.9 Requirements for Interaction of Tensile and Shear Forces:** For anchors or groups of anchors that are subject to the effects of combined tension and shear forces, the design must be performed in accordance with ACI 318-19 17.8, ACI 318-14 17.6 or ACI 318-11 D.7, as applicable.

**4.1.10 Requirements for Minimum Member Thickness, Minimum Anchor Spacing and Minimum Edge Distance:** In lieu of ACI 318-19 17.9.2, ACI 318-14 17.7.1 and 17.7.3 or ACI 318-11 D.8.1 and D.8.3, respectively, as applicable, values of  $s_{min}$  and  $c_{min}$  as given in Table 3 of this report must be used. In lieu of ACI 318-19 17.9.4, ACI 318-14 17.7.5 or ACI 318-11 D.8.5, as applicable, minimum member thicknesses  $h_{min}$  as given in Tables 3 and 4 of this report must be used. Additional combinations for minimum edge distance,  $c_{min}$ , and spacing,  $s_{min}$ , may be derived by linear interpolation between the given boundary values as described in Figure 4.

For carbon steel KB-TZ2 anchors installed in the top side of sand-lightweight or normal-weight concrete over profile steel deck floor and roof assemblies, the anchors must be installed in accordance with Table 9 and Figure 5D.

For carbon steel KB-TZ2 anchors installed in the soffit of sand-lightweight or normal-weight concrete over profile steel deck floor and roof assemblies, the anchors must be installed in accordance with Figure 5A, Figure 5B and Figure 5C and shall have an axial spacing along the flute equal to the greater of  $3h_{ef}$  or 1.5 times the flute width.

**4.1.11 Requirements for Critical Edge Distance:** In applications where  $c < c_{ac}$  and supplemental reinforcement to control splitting of the concrete is not present, the concrete breakout strength in tension for uncracked concrete, calculated in accordance with ACI 318-19 17.6.2, ACI 318-14 17.4.2 or ACI 318-11 D.5.2, as applicable, must be further multiplied by the factor  $\Psi_{cp,N}$  as given by Eq-3:

$$\Psi_{cp,N} = \frac{c}{c_{ac}} \quad (\text{Eq-3})$$

whereby the factor  $\Psi_{cp,N}$  need not be taken as less than  $\frac{1.5 h_{ef}}{c_{ac}}$ . For all other cases,  $\Psi_{cp,N} = 1.0$ . In lieu of using ACI 318-19 17.9.5, ACI 318-14 17.7.6 or ACI 318-11 D.8.6, as applicable, values of  $c_{ac}$  must comply with Table 4 or Table 5.

**4.1.12 Lightweight Concrete:** For the use of anchors in lightweight concrete, the modification factor  $\lambda_a$  equal to  $0.8\lambda$  is applied to all values of  $\sqrt{f'_c}$  affecting  $N_n$  and  $V_n$ .

For ACI 318-19 (2021 IBC), ACI 318-14 (2018 and 2015 IBC) and ACI 318-11 (2012 IBC),  $\lambda$  shall be determined in accordance with the corresponding version of ACI 318.

For anchors installed in the soffit of sand-lightweight concrete-filled steel deck and floor and roof assemblies, further reduction of the pullout values provided in this report is not required.

#### 4.2 Allowable Stress Design (ASD):

**4.2.1 General:** Design values for use with allowable stress design (working stress design) load combinations calculated in accordance with Section 1605.1 of the 2021 IBC or Section 1605.3 of the 2018, 2015 and 2012 IBC, must be established as follows:

$$T_{allowable,ASD} = \frac{\phi N_n}{\alpha}$$



$$V_{allowable,ASD} = \frac{\phi V_n}{\alpha}$$

where:

$T_{allowable,ASD}$  = Allowable tension load (lbf or kN).

$V_{allowable,ASD}$  = Allowable shear load (lbf or kN).

$\phi N_n$  = Lowest design strength of an anchor or anchor group in tension as determined in accordance with ACI 318 (-19 and -14) Chapter 17 and 2021, 2018 and 2015 IBC Section 1905.1.8, ACI 318-11 Appendix D, and Section 4.1 of this report, as applicable (lbf or N). For 2012 IBC, Section 1905.1.9 shall be omitted.

$\phi V_n$  = Lowest design strength of an anchor or anchor group in shear as determined in accordance with ACI 318 (-19 and -14) Chapter 17 and 2021, 2018 and 2015 IBC Section 1905.1.8, ACI 318-11 Appendix D, and Section 4.1 of this report, as applicable (lbf or N). For 2012 IBC, Section 1905.1.9 shall be omitted.

$\alpha$  = Conversion factor calculated as a weighted average of the load factors for the controlling load combination. In addition,  $\alpha$  must include all applicable factors to account for nonductile failure modes and required over-strength.

The requirements for member thickness, edge distance and spacing, described in this report, must apply.

**4.2.2 Interaction of Tensile and Shear Forces:** The interaction must be calculated and consistent with ACI 318-19 17.8, ACI 318-14 17.6 or ACI 318-11 D.7, as applicable, as follows:

For shear loads  $V_{applied} \leq 0.2V_{allowable,ASD}$ , the full allowable load in tension is permitted.

For tension loads  $T_{applied} \leq 0.2T_{allowable,ASD}$ , the full allowable load in shear is permitted.

For all other cases:

$$\frac{T_{applied}}{T_{allowable,ASD}} + \frac{V_{applied}}{V_{allowable,ASD}} \leq 1.2 \quad (\text{Eq-4})$$

### 4.3 Installation:

Installation parameters are provided in Table 1 and Figure 2, Figure 5A, Figure 5B, Figure 5C and Figure 5D. Anchor locations must comply with this report and plans and specifications approved by the code official. The Hilti KB-TZ2 must be installed in accordance with manufacturer's published instructions and this report. In case of conflict, this report governs. Anchors must be installed in holes drilled into the concrete using carbide-tipped masonry drill bits complying with ANSI B212.15-1994, using the Hilti SafeSet System™ with Hilti TE-YD or TE-CD Hollow Drill Bits complying with ANSI B212.15-1994 with a Hilti vacuum in accordance with Figure 6 and Figure 7, or using Hilti SPX-T core bits in accordance with Figure 7. The Hollow Drill Bits are not permitted for use with the 1/4-inch- and 3/8-inch diameter KB-TZ2 anchors. The Hilti SPX-T core bits are not permitted for use with the 1/4-inch-diameter KB-TZ2 anchors. The minimum drilled hole depth,  $h_o$ , is given in Table 1. If dust and debris is removed from the drilled hole with the Hilti TE-YD or TE-CD Hollow Drill Bits, the DRS attachment system, or compressed air or a manual pump,  $h_{nom}$  is achieved at the specified value of  $h_o$  noted in Table

1. The anchor must be hammered into the predrilled hole until  $h_{nom}$  is achieved. The nut must be tightened against the washer until the torque values specified in Table 1 are achieved, or the anchors may be installed using the Hilti AT Tool in accordance with Figure 7. The Hilti AT Tool is not permitted for use with the 1/4-inch- and 3/4-inch- diameter KB-TZ2 anchors. For installation in the soffit of concrete on steel deck assemblies, the hole diameter in the steel deck must not exceed the diameter of the hole in the concrete by more than 1/8 inch (3.2 mm). For member thickness and edge distance restrictions for installations into the soffit of concrete on steel deck assemblies, see Figure 5A, Figure 5B, and Figure 5C.

### 4.4 Special Inspection:

Periodic special inspection is required in accordance with Section 1705.1.1 and Table 1705.3 of the 2021, 2018, 2015 and 2012 IBC, as applicable. The special inspector must make periodic inspections during anchor installation to verify anchor type, anchor dimensions, concrete type, concrete compressive strength, anchor spacing, edge distances, concrete member thickness, tightening torque, hole dimensions, anchor embedment and adherence to the manufacturer's printed installation instructions. The special inspector must be present as often as required in accordance with the "statement of special inspection." Under the IBC, additional requirements as set forth in Sections 1705, 1706 and 1707 must be observed, where applicable.

## 5.0 CONDITIONS OF USE

The Hilti KB-TZ2 anchors described in this report comply with the codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1** Anchor sizes, dimensions, minimum embedment depths and other installation parameters as set forth in this report.
- 5.2** The anchors must be installed in accordance with the manufacturer's published instructions and this report. In case of conflict, this report governs.
- 5.3** Anchors must be limited to use in cracked and uncracked normal-weight concrete and lightweight concrete having a specified compressive strength,  $f'_c$ , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa), and cracked and uncracked normal-weight or sand-lightweight concrete over metal deck having a specified compressive strength,  $f'_c$ , of 3,000 psi to 8,500 psi (20.7 MPa to 58.6 MPa).
- 5.4** The values of  $f'_c$  used for calculation purposes must not exceed 8,000 psi (55.1 MPa).
- 5.5** The concrete shall have attained its minimum design strength prior to installation of the anchors and must have a minimum age of 21 days.
- 5.6** Strength design values must be established in accordance with Section 4.1 of this report.
- 5.7** Allowable design values are established in accordance with Section 4.2.
- 5.8** Anchor spacing and edge distance as well as minimum member thickness must comply with Tables 3 and 9, and Figure 5A, Figure 5B, Figure 5C and Figure 5D.
- 5.9** Prior to installation, calculations and details demonstrating compliance with this report must be submitted to the code official. The calculations and details must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.10** Since an ICC-ES acceptance criteria for evaluating data to determine the performance of expansion

anchors subjected to fatigue or shock loading is unavailable at this time, the use of these anchors under such conditions is beyond the scope of this report.

- 5.11** Anchors may be installed in regions of concrete where cracking has occurred or where analysis indicates cracking may occur ( $f_t > f_r$ ), subject to the conditions of this report.
- 5.12** Anchors may be used to resist short-term loading due to wind or seismic forces in locations designated as Seismic Design Categories A through F of the IBC, subject to the conditions of this report.
- 5.13** Where not otherwise prohibited in the code, KB-TZ2 anchors are permitted for use with fire-resistance-rated construction provided that at least one of the following conditions is fulfilled:
- Anchors are used to resist wind or seismic forces only.
  - Anchors that support a fire-resistance-rated envelope or a fire-resistance-rated membrane are protected by approved fire-resistance-rated materials, or have been evaluated for resistance to fire exposure in accordance with recognized standards.
  - Anchors are used to support nonstructural elements.
- 5.14** Use of zinc-coated carbon steel anchors is limited to dry, interior locations.
- 5.15** Use of anchors made of stainless steel as specified in this report are permitted for exterior exposure and damp environments.
- 5.16** Use of anchors made of stainless steel as specified in this report are permitted for contact with preservative-treated and fire-retardant-treated wood.
- 5.17** Anchors are manufactured by Hilti AG under an approved quality-control program with inspections by ICC-ES.

- 5.18** Special inspection must be provided in accordance with Section 4.4.

## **6.0 EVIDENCE SUBMITTED**

- 6.1** Data in accordance with the ICC-ES Acceptance Criteria for Mechanical Anchors in Concrete Elements (AC193), dated October 2017, (editorially revised December 2020), which incorporates requirements in ACI 355.2-19 and ACI 355.2-07 for use in cracked and uncracked concrete.
- 6.2** Quality-control documentation.

## **7.0 IDENTIFICATION**

- 7.1** The anchors are identified by packaging labeled with the manufacturer's name (Hilti, Inc.) and contact information, anchor name, anchor size, and evaluation report number (ESR-4266). The anchors have the letters KB-TZ2 embossed on the anchor stud and a notch or notches embossed into the anchor head. The letters and notches are visible after installation for verification as depicted in Figure 3 of this report. The number of notches indicate material type. The letter system indicating length embossed on the head of the anchor is described in Table 2.
- 7.2** The report holder's contact information is the following:

**HILTI, INC.**  
**7250 DALLAS PARKWAY, SUITE 1000**  
**PLANO, TEXAS 75024**  
**(918) 872-8000**  
[www.hilti.com](http://www.hilti.com)

TABLE 1—SETTING INFORMATION

Setting information	Sym.	Units	Nominal anchor diameter (in.)													
			1/4	3/8			1/2				5/8			3/4		
Nominal bit diameter	$d_o$	In.	1/4	3/8			1/2				5/8			3/4		
Effective min. embedment	$h_{ef}$	In. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2-1/2 (64)	1-1/2 <sup>1</sup> (38)	2 (51)	2-1/2 (64)	3-1/4 (83)	2-3/4 (70)	3-1/4 (83)	4 (102)	3-1/4 (83)	3-3/4 (95)	4-3/4 (121)
Nominal embedment	$h_{nom}$	in. (mm)	1-3/4 (44)	1-7/8 (48)	2-1/2 (64)	3 (76)	2 <sup>1</sup> (51)	2-1/2 (64)	3 (76)	3-3/4 (95)	3-1/4 (83)	3-3/4 (95)	4-1/2 (114)	4 (102)	4-1/2 (114)	5-1/2 (140)
Min. hole depth	$h_o$	In. (mm)	2 (51)	2 (51)	2-3/4 (70)	3-1/4 (83)	2-1/4 <sup>1</sup> (57)	2-3/4 (70)	3-1/4 (83)	4-1/4 (108)	3-3/4 (95)	4-1/4 (108)	4-3/4 (121)	4-1/4 (108)	4-3/4 (121)	5-3/4 (146)
Installation torque Carbon steel <sup>1</sup>	$T_{inst}$	ft-lb (Nm)	4 (5)	30 (41)			50 (68)				40 (54)			110 (149)		
Installation torque Stainless steel <sup>1</sup>	$T_{inst}$	ft-lb (Nm)	6 (8)	30 (41)			40 (54)				60 (81)			125 (169)		
Fixture hole diameter	$d_h$	In. (mm)	5/16 (7.9)	7/16 (11.1)			9/16 (14.3)				11/16 (17.5)			13/16 (20.6)		

<sup>1</sup> Design information for  $h_{ef} = 1-1/2$  is only applicable to carbon steel (CS) KB-TZ2 bolts.

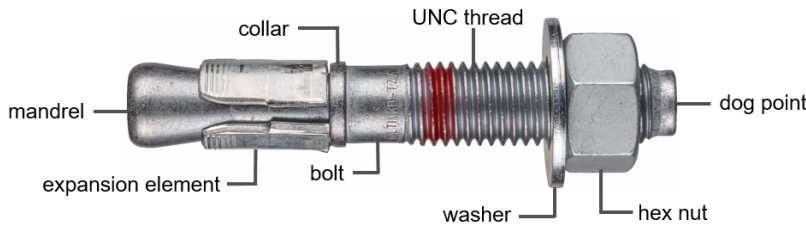


FIGURE 1—HILTI CARBON STEEL KWIK BOLT TZ (KB-TZ2)

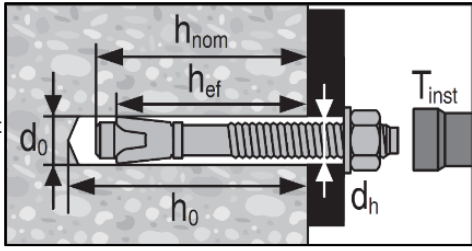


FIGURE 2—HILTI KB-TZ2 INSTALLED

TABLE 2—LENGTH IDENTIFICATION SYSTEM (CARBON STEEL AND STAINLESS STEEL ANCHORS)

Length ID marking on bolt head		A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U	V	W
Length of anchor, $\ell_{anch}$ (inches)	From	1½	2	2½	3	3½	4	4½	5	5½	6	6½	7	7½	8	8½	9	9½	10	11	12	13	14	15
	Up to but not including	2	2½	3	3½	4	4½	5	5½	6	6½	7	7½	8	8½	9	9½	10	11	12	13	14	15	16

For SI: 1 inch = 25.4 mm.

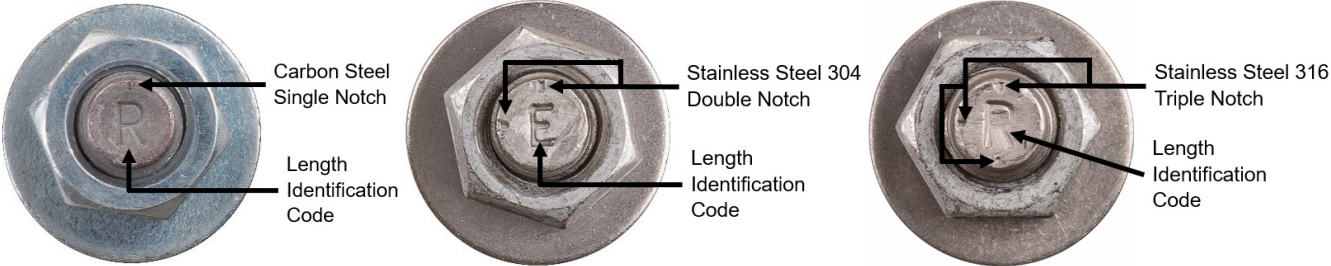


FIGURE 3—BOLT HEAD WITH LENGTH IDENTIFICATION CODE AND KB-TZ2 HEAD NOTCH EMBOSSEMENT

TABLE 3—MINIMUM EDGE DISTANCE, SPACING AND CONCRETE THICKNESS FOR KB-TZ2

Setting information	Symbol	Units	Nominal anchor dia. (in.)													
			1/4	3/8			1/2				5/8			3/4		
Effective min. embedment	$h_{ef}$	in. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2-1/2 (64)	1-1/2 (38)	2 (51)	2-1/2 (64)	3-1/4 (83)	2-3/4 (70)	3-1/4 (83)	4 (102)	3-1/4 (83)	3-3/4 (95)	4-3/4 (121)
Min. member thickness	$h_{min}$	in. (mm)	3-1/4 (83)	3-1/4 (83)	4 (102)	5 (127)	3-1/2 (89)	4 (102)	5 (127)	5-1/2 (140)	5 (127)	5-1/2 (140)	6 (152)	5-1/2 (140)	6 (152)	8 (203)
Carbon Steel																
Min. edge distance	$c_{min}$	in. (mm)	1-1/2 (38)	5 (127)	2-1/2 (64)	2-1/2 (64)	8 (203)	2-3/4 (70)	2-3/4 (70)	2-1/4 (57)	4-1/2 (114)	3-1/2 (89)	2-3/4 (70)	5 (127)	4 (102)	3-1/2 (89)
	for $s \geq$	in. (mm)	1-1/2 (38)	8 (203)	6 (152)	5 (127)	12 (305)	5-1/2 (140)	9-3/4 (248)	5-1/4 (133)	6-1/2 (165)	5-1/2 (140)	7-1/4 (184)	10 (254)	5-3/4 (146)	5-1/2 (140)
Min. anchor spacing	$s_{min}$	in. (mm)	1-1/2 (38)	5 (127)	2-1/4 (57)	2 (51)	12 (305)	3-1/2 (89)	3 (76)	2 (51)	4-1/2 (114)	2-3/4 (70)	2-1/4 (57)	4-1/2 (114)	3-3/4 (95)	3-3/4 (95)
	for $c \geq$	In. (mm)	1-1/2 (38)	8 (203)	3-1/2 (89)	4 (102)	8 (203)	10 (254)	8 (203)	4-3/4 (121)	5-1/2 (140)	7 (178)	4-1/4 (108)	6 (152)	7-1/2 (191)	4-3/4 (121)
Stainless Steel																
Min. edge distance	$c_{min}$	in. (mm)	1-1/2 (38)	5 (127)	2-1/2 (64)	2-1/2 (64)		2-3/4 (70)	2-1/2 (64)	2-1/4 (57)	4 (102)	3-1/4 (83)	2-1/4 (57)	5 (127)	4 (102)	3-3/4 (95)
	for $s \geq$	in. (mm)	1-1/2 (38)	8 (203)	5 (127)	5 (127)		5-1/2 (140)	4-1/2 (114)	5-1/4 (133)	7 (178)	5-1/2 (140)	7 (178)	11 (279)	7-1/2 (191)	5-3/4 (146)
Min. anchor spacing	$s_{min}$	in. (mm)	1-1/2 (38)	5 (127)	2-1/4 (57)	2-1/4 (57)		2-3/4 (70)	2-1/2 (64)	2 (51)	5-1/2 (140)	2-3/4 (70)	3 (76)	5 (127)	4 (102)	4 (102)
	for $c \geq$	In. (mm)	1-1/2 (38)	8 (203)	4 (102)	3-1/2 (89)		4-1/8 (105)	5 (127)	4-3/4 (121)	5-1/2 (140)	4 (102)	4-1/4 (108)	8 (203)	6 (152)	5-1/4 (133)

For SI: 1 inch = 25.4 mm

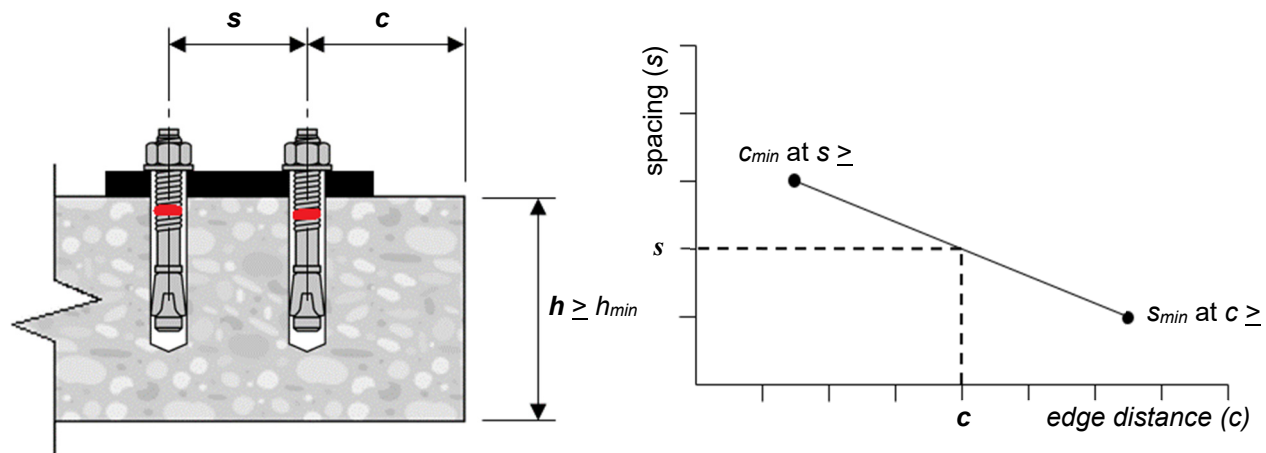


FIGURE 4—INTERPOLATION OF MINIMUM EDGE DISTANCE AND ANCHOR SPACING

TABLE 4—HILTI CARBON STEEL KB-TZ2 DESIGN INFORMATION FOR HAMMER AND CORE DRILLED INSTALLATIONS, TENSION

Design parameter	Sym bol	Units	Nominal anchor diameter (in)													
			1/4	3/8			1/2				5/8			3/4		
Effective min. embedment <sup>1</sup>	$h_{ef}$	in. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2-1/2 (64)	1-1/2 (38)	2 (51)	2-1/2 (64)	3-1/4 (83)	2-3/4 (70)	3-1/4 (83)	4 (102)	3-1/4 (83)	3-3/4 (95)	4-3/4 (121)
Tension, steel failure modes																
Strength reduction factor for steel in tension <sup>2</sup>	$\Phi_{sa,N}$	-	0.75	0.75			0.75				0.75			0.75		
Min. specified yield strength	$f_y$	lb/in <sup>2</sup> (N/mm <sup>2</sup> )	100,900 (696)	100,900 (696)			96,300 (664)				87,000 (600)			84,700 (584)		
Min. specified ult. strength	$f_{uta}$	lb/in <sup>2</sup> (N/mm <sup>2</sup> )	122,400 (844)	126,200 (870)			114,000 (786)				106,700 (736)			105,900 (730)		
Effective tensile stress area	$A_{se,N}$	In <sup>2</sup> (mm <sup>2</sup> )	0.024 (15.4)	0.051 (33.2)			0.099 (63.6)				0.164 (106.0)			0.239 (154.4)		
Steel strength in tension	$N_{sa}$	lb (kN)	2,920 (13.0)	6,490 (28.9)			11,240 (50.0)				17,535 (78.0)			25,335 (112.7)		
Tension, concrete failure modes																
Anchor category	-	-	3	1			1				1			1		
Strength reduction factor for concrete and pullout failure in tension, (Condition B – supplementary reinforcement not present) <sup>3,7</sup>	$\Phi_{c,N}$ , $\Phi_{p,N}$	-	0.45	0.65			0.65				0.65			0.65		
Effectiveness factor for uncracked concrete	$k_{uncr}$	-	24	24			27		24		24			27	27 <sup>6</sup>	24
Effectiveness factor for cracked concrete <sup>6</sup>	$k_{cr}$	-	17	21		17	24	21		17	21		17	21		
Modification factor for anchor resistance, tension, uncracked concrete <sup>4</sup>	$\Psi_{c,N}$	-	1.0	1.0			1.0				1.0			1.0		
Critical edge distance	$c_{ac}$	in. (mm)	4 (102)	5 (127)	4-3/8 (111)	5-1/2 (140)	8 (203)	5-1/2 (140)	6-3/4 (171)	10 (254)	10 (254)	11-1/2 (292)	8-3/4 (222)	12 (305)	10 (254)	9 (229)
Pullout strength uncracked conc. <sup>5</sup>	$N_{p,uncr}$	lb (kN)	2,100 (9.3)	N/A	N/A	4,180 (18.6)	N/A	N/A	N/A	N/A	5,380 (23.9)	N/A	8,995 (40.0)	N/A	N/A	N/A
Pullout strength cracked conc. <sup>5</sup>	$N_{p,cr}$	lb (kN)	625 (2.8)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	8,835 (39.3)
Pullout strength seismic <sup>5</sup>	$N_{p,eq}$	lb (kN)	625 (2.8)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	8,700 (38.7)
Normalization factor, uncracked concrete	$n_{uncr}$	-	0.20	0.22	0.24	0.35	0.50	0.42	0.29	0.35	0.50	0.48	0.50	0.35	0.31	0.39
Normalization factor, cracked concrete, seismic	$n_{cr}$	-	0.39	0.50	0.46	0.28	0.47	0.50	0.48	0.40	0.50	0.47	0.50	0.36	0.42	0.29
Tension, axial stiffness																
Axial stiffness in service load range	$\beta_{uncr}$	lb/in.	322,360	131,570			158,585				290,360			412,335		
	$\beta_{cr}$	lb/in.	31,035	91,335			113,515				167,365			62,180		

For SI: 1 inch = 25.4 mm, 1 lbf = 4.45 N, 1 psi = 0.006895 MPa. For pound-inch units: 1 mm = 0.03937 inches.

<sup>1</sup> Figure 2 of this report illustrates the installation parameters.

<sup>2</sup> The KB-TZ2 is considered a ductile steel element in accordance with ACI 318 (-19 and -14) 2.3 or ACI 318-11 D.1.

<sup>3</sup> For use with the load combinations of ACI 318 (-19 and -14) Section 5.3, ACI 318-11 Section 9.2 or 2021 IBC Section 1605.1 or 2018, 2015, 2012 IBC Section 1605.2. Condition B (supplementary reinforcement not present) applies where supplementary reinforcement in conformance with ACI 318-19 Table 17.5.3(b) or (c), ACI 318-14 section 17.3.3 (c) or ACI 318-11 Section 4.3 (c) is not provided, or where pryout strength governs. For cases where the presence of supplementary reinforcement can be verified, the resistance modification factors associated with Condition A (supplementary reinforcement present) for concrete breakout failure may be used.

<sup>4</sup> For all design cases,  $\Psi_{c,N} = 1.0$ . The appropriate effectiveness factor for cracked concrete ( $k_{cr}$ ) or uncracked concrete ( $k_{uncr}$ ) must be used.

<sup>5</sup> For all design cases,  $\Psi_{c,P} = 1.0$ . Tabular value for pullout strength is for a concrete compressive strength of 2,500 psi (17.2 MPa). Pullout strength for concrete compressive strength greater than 2,500 psi (17.2 MPa) may be increased by multiplying the tabular pullout strength by  $(f'_c / 2,500)^n$  for psi, or  $(f'_c / 17.2)^n$  for MPa, where n is given as  $n_{uncr}$  for uncracked concrete and  $n_{cr}$  for cracked concrete and seismic. NA (not applicable) denotes that pullout strength does not need to be considered for design.

<sup>6</sup> For core drill installations,  $k_{uncr} = 24$  for 3/4-inch diameter anchors installed at 3 3/4 inches (95 mm) effective embedment.

<sup>7</sup> The supplementary reinforcement classifications "Condition A" and "Condition B" have been replaced by ACI 318-19 Table 17.5.3 (c).



TABLE 5—HILTI STAINLESS STEEL KB-TZ2 DESIGN INFORMATION FOR HAMMER AND CORE DRILLED INSTALLATIONS, TENSION

Design parameter	Symbol	Units	Nominal anchor diameter (in)												
			1/4	3/8			1/2			5/8			3/4		
Effective min. embedment <sup>1</sup>	$h_{ef}$	in. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2-1/2 (64)	2 (51)	2-1/2 (64)	3-1/4 (83)	2-3/4 (70)	3-1/4 (83)	4 (102)	3-1/4 (83)	3-3/4 (95)	4-3/4 (121)
Tension, steel failure modes															
Strength reduction factor for steel in tension <sup>2</sup>	$\phi_{sa,N}$	-	0.75	0.75			0.75			0.75			0.75		
Min. specified yield strength	$f_y$	lb/in <sup>2</sup> (N/mm <sup>2</sup> )	100,900 (696)	96,300 (664)			96,300 (664)			91,600 (632)			84,100 (580)		
Min. specified ult. strength	$f_{uta}$	lb/in <sup>2</sup> (N/mm <sup>2</sup> )	122,400 (844)	120,100 (828)			120,400 (830)			114,600 (790)			100,500 (693)		
Effective tensile stress area	$A_{se,N}$	ln <sup>2</sup> (mm <sup>2</sup> )	0.024 (15.4)	0.051 (33.2)			0.099 (63.6)			0.164 (106.0)			0.239 (154.4)		
Steel strength in tension	$N_{sa}$	lb (kN)	2,920 (13.0)	6,180 (27.5)			11,870 (52.8)			18,835 (83.8)			24,045 (107.0)		
Tension, concrete failure modes															
Anchor category	-	-	3	1			1			1			1		
Strength reduction factor for concrete and pullout failure in tension, (Condition B – supplementary reinforcement not present) <sup>3,8</sup>	$\phi_{c,N}$ , $\phi_{p,N}$	-	0.45	0.65			0.65			0.65			0.65		
Effectiveness factor for uncracked concrete	$k_{uncr}$	-	24	24			24			24			24	27 <sup>6</sup>	24
Effectiveness factor for cracked concrete	$k_{cr}$	-	17	21		17	17	21	17	21		17	21	21 <sup>6</sup>	21
Modification factor for anchor resistance, tension, uncracked concrete <sup>4</sup>	$\psi_{c,N}$	-	1.0	1.0			1.0			1.0			1.0		
Critical edge distance	$c_{ac}$	in. (mm)	4 (102)	4-1/2 (114)	5-1/2 (140)	4-1/8 (105)	5-1/2 (140)	6-1/4 (159)	7-1/2 (191)	10 (254)	6-1/2 (165)	8-3/4 (222)	12 (305)	10 (254)	10 (254)
Pullout strength uncracked concrete <sup>5</sup>	$N_{p,uncr}$	lb (kN)	1,570 (7.0)	N/A	N/A	4,185 (18.6)	3,380 (15.0)	4,010 (17.8)	5,500 (24.5)	4,085 (18.2)	6,015 (26.8)	8,050 (35.8)	N/A	N/A	N/A
Pullout strength cracked concrete <sup>5</sup>	$N_{p,cr}$	lb (kN)	670 (3.0)	N/A	N/A	N/A	N/A	N/A	N/A <sup>7</sup>	N/A	N/A	N/A	N/A	N/A	8,795 (39.1)
Pullout strength seismic <sup>5</sup>	$N_{p,eq}$	lb (kN)	670 (3.0)	N/A	N/A	N/A	N/A	N/A	N/A <sup>7</sup>	N/A	N/A	N/A	N/A	N/A	8,795 (39.1)
Normalization factor, uncracked concrete	$n_{uncr}$	-	0.39	N/A	N/A	0.37	0.46	0.50	0.50	0.50	0.42	0.47	N/A	N/A	N/A
Normalization factor, cracked concrete, seismic	$n_{cr}$	-	0.50	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	0.50
Tension, axial stiffness															
Axial stiffness in service load range	$\beta_{uncr}$	lb/in.	166,490	175,800			137,145			153,925			342,680		
	$\beta_{cr}$	lb/in.	33,805	79,860			97,985			69,625			75,715		

For SI: 1 inch = 25.4 mm, 1 lbf = 4.45 N, 1 psi = 0.006895 MPa For pound-inch units: 1 mm = 0.03937 inches.

<sup>1</sup> Figure 2 of this report illustrates the installation parameters.

<sup>2</sup> The KB-TZ2 is considered a ductile steel element in accordance with ACI 318 (-19 and -14) 2.3 or ACI 318-11 D.1.

<sup>3</sup> For use with the load combinations of ACI 318 (-19 and -14) Section 5.3, ACI 318-11 Section 9.2 or 2021 IBC Section 1605.1 or 2018, 2015, 2012 IBC Section 1605.2. Condition B (supplementary reinforcement not present) applies where supplementary reinforcement in conformance with ACI 318-19 Table 17.5.3(b) or (c), ACI 318-14 section 17.3.3 (c) or ACI 318-11 Section 4.3 (c) is not provided, or where pryout strength governs. For cases where the presence of supplementary reinforcement can be verified, the resistance modification factors associated with Condition A (supplementary reinforcement present) for concrete breakout failure may be used.

<sup>4</sup> For all design cases,  $\psi_{c,N} = 1.0$ . The appropriate effectiveness factor for cracked concrete ( $k_{cr}$ ) or uncracked concrete ( $k_{uncr}$ ) must be used.

<sup>5</sup> For all design cases,  $\psi_{c,p} = 1.0$ . Tabular value for pullout strength is for a concrete compressive strength of 2,500 psi (17.2 MPa). Pullout strength for concrete compressive strength greater than 2,500 psi (17.2 MPa) may be increased by multiplying the tabular pullout strength by  $(f_c / 2,500)^n$  for psi, or  $(f_c / 17.2)^n$  for MPa, where n is given as  $n_{uncr}$  for uncracked concrete and  $n_{cr}$  for cracked concrete. NA (not applicable) denotes that pullout strength does not need to be considered for design.

<sup>6</sup> For core drill installations,  $k_{uncr} = 24$  and  $k_{cr} = 17$  for 3/4-inch diameter anchors installed at 3 3/4 inches (95 mm) effective embedment.

<sup>7</sup> For core drill installations,  $N_{p,cr} = 4245$  lb (18.9 kN) and  $N_{p,eq} = 4245$  lb (18.9 kN) for 1/2-inch diameter anchors installed at 3 3/4 inches (95 mm) effective embedment.

<sup>8</sup> The supplementary reinforcement classifications "Condition A" and "Condition B" have been replaced by ACI 318-19 Table 17.5.3 (c).

TABLE 6—HILTI CARBON STEEL KB-TZ2 DESIGN INFORMATION FOR HAMMER AND CORE DRILLED INSTALLATIONS, SHEAR

Design parameter	Symbol	Units	Nominal anchor diameter (in)													
			1/4	3/8			1/2				5/8			3/4		
Anchor O.D.	$d_a$	in. (mm)	0.250 (6.4)	0.375 (9.5)			0.500 (12.7)				0.625 (15.9)			0.750 (19.1)		
Effective min. embedment <sup>1</sup>	$h_{ef}$	in. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2-1/2 (64)	1-1/2 (38)	2 (51)	2-1/2 (64)	3-1/4 (83)	2-3/4 (70)	3-1/4 (83)	4 (102)	3-1/4 (83)	3-3/4 (95)	4-3/4 (121)
Shear, steel failure modes																
Strength reduction factor for steel in shear <sup>2</sup>	$\Phi_{sa,V}$	-	0.65	0.65			0.65				0.65			0.65		
Steel strength in shear	$V_{sa}$	lb (kN)	1,345 (6.0)	3,225 (14.4)	3,385 (15.1)		5,535 (24.6)		6,875 (30.6)		10,255 (45.6)			13,805 (61.4)		
Steel strength in shear, seismic	$V_{sa,eq}$	lb (kN)	1,345 (6.0)	3,225 (14.4)	3,385 (15.1)		5,535 (24.6)		6,875 (30.6)		10,255 (45.6)			13,805 (61.4)		
Shear, concrete failure modes																
Strength reduction factor for concrete breakout and pryout failure in shear, (Condition B – supplementary reinforcement not present) <sup>3,4</sup>	$\Phi_{c,V}, \Phi_{p,V}$	-	0.70	0.70			0.70				0.70			0.70		
Load bearing length of anchor in shear	$l_e$	in. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2-1/2 (64)	1-1/2 (38)	2 (51)	2-1/2 (64)	3-1/4 (83)	2-3/4 (70)	3-1/4 (83)	4 (102)	3-1/4 (83)	3-3/4 (95)	4-3/4 (121)
Coefficient for pryout strength	$k_{cp}$	-	1	1	1	2	1	1	2	2	2	2	2	2	2	2

For SI: 1 inch = 25.4 mm, 1 lbf = 4.45 N, 1 psi = 0.006895 MPa For pound-inch units: 1 mm = 0.03937 inches.

<sup>1</sup> Figure 2 of this report illustrates the installation parameters.

<sup>2</sup> The KB-TZ2 is considered a ductile steel element in accordance with ACI 318 (-19 and -14) 2.3 or ACI 318-11 D.1.

<sup>3</sup> For use with the load combinations of ACI 318 (-19 and -14) Section 5.3, ACI 318-11 Section 9.2 or 2021 IBC Section 1605.1 or 2018, 2015, 2012 IBC Section 1605.2. Condition B (supplementary reinforcement not present) applies where supplementary reinforcement in conformance with ACI 318-19 Table 17.5.3(b) or (c), ACI 318-14 section 17.3.3 (c) or ACI 318-11 Section 4.3 (c) is not provided, or where pryout strength governs. For cases where the presence of supplementary reinforcement can be verified, the resistance modification factors associated with Condition A (supplementary reinforcement present) for concrete breakout failure may be used.

<sup>4</sup> The supplementary reinforcement classifications "Condition A" and "Condition B" have been replaced by ACI 318-19 Table 17.5.3 (c).

TABLE 7—HILTI STAINLESS STEEL KB-TZ2 DESIGN INFORMATION FOR HAMMER AND CORE DRILLED INSTALLATIONS, SHEAR

Design parameter	Symbol	Units	Nominal anchor diameter												
			1/4	3/8			1/2			5/8			3/4		
Anchor O.D.	$d_a$	in. (mm)	0.250 (6.4)	0.375 (9.5)			0.500 (12.7)			0.625 (15.9)			0.750 (19.1)		
Effective min. embedment <sup>1</sup>	$h_{ef}$	in. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2-1/2 (64)	2 (51)	2-1/2 (64)	3-1/4 (83)	2-3/4 (70)	3-1/4 (83)	4 (102)	3-1/4 (83)	3-3/4 (95)	4-3/4 (121)
Shear, steel failure modes															
Strength reduction factor for steel in shear <sup>2</sup>	$\Phi_{sa,V}$	-	0.65	0.65			0.65			0.65			0.65		
Steel strength in shear	$V_{sa}$	lb (kN)	1,460 (6.5)	4,615 (20.5)	4,885 (21.7)		8,345 (37.1)			12,355 (55.0)			16,560 (73.7)		
Steel strength in shear, seismic	$V_{sa,eq}$	lb (kN)	1,110 (4.9)	4,615 (20.5)	4,885 (21.7)		8,345 (37.1)			12,355 (55.0)			13,470 (59.9)		
Shear, concrete failure modes															
Strength reduction factor for concrete breakout and pryout failure in shear, (Condition B—supplementary reinforcement not present) <sup>3,4</sup>	$\Phi_{c,V}, \Phi_{p,V}$	-	0.7	0.7			0.7			0.7			0.7		
Load bearing length of anchor in shear	$l_e$	in. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2-1/2 (64)	2 (51)	2-1/2 (64)	3-1/4 (83)	2-3/4 (70)	3-1/4 (83)	4 (102)	3-1/4 (83)	3-3/4 (95)	4-3/4 (121)
Coefficient for pryout strength	$k_{cp}$	-	1	1	1	2	1	2	2	2	2	2	2	2	2

For SI: 1 inch = 25.4 mm, 1 lbf = 4.45 N, 1 psi = 0.006895 MPa For pound-inch units: 1 mm = 0.03937 inches.

<sup>1</sup> Figure 2 of this report illustrates the installation parameters.

<sup>2</sup> The KB-TZ2 is considered a ductile steel element in accordance with ACI 318 (-19 and -14) 2.3 or ACI 318-11 D.1.

<sup>3</sup> For use with the load combinations of ACI 318 (-19 and -14) Section 5.3, ACI 318-11 Section 9.2 or 2021 IBC Section 1605.1 or 2018, 2015, 2012 IBC Section 1605.2. Condition B (supplementary reinforcement not present) applies where supplementary reinforcement in conformance with ACI 318-19 Table 17.5.3(b) or (c), ACI 318-14 section 17.3.3 (c) or ACI 318-11 Section 4.3 (c) is not provided, or where pryout strength governs. For cases where the presence of supplementary reinforcement can be verified, the resistance modification factors associated with Condition A (supplementary reinforcement present) for concrete breakout failure may be used.

<sup>4</sup> The supplementary reinforcement classifications "Condition A" and "Condition B" have been replaced by ACI 318-19 Table 17.5.3 (c).

**TABLE 8—HILTI KB-TZ2 CARBON STEEL ANCHORS TENSION AND SHEAR DESIGN DATA FOR INSTALLATION IN THE SOFFIT OF 3000 PSI, LIGHTWEIGHT CONCRETE-FILLED PROFILE STEEL DECK ASSEMBLIES FOR HAMMER AND CORE DRILLED INSTALLATIONS<sup>1,2,3</sup>**

Design parameter	Symbol	Units	Anchor Diameter											
			1/4	3/8			1/2			5/8		3/4		
Effective min. embedment <sup>1</sup>	$h_{ef}$	in.	1-1/2	1-1/2	2	2-1/2	1-1/2	2	2-1/2	3-1/4	2-3/4	4	3-1/4	3-3/4 <sup>9</sup>
Minimum hole depth	$h_o$	in.	2	2	2-3/4	3-1/4	2-1/4	2-3/4	3-1/4	4-1/4	3-3/4	4-3/4	4-1/4	4-3/4
Loads According to Figure 5A														
Minimum concrete thickness over upper flute <sup>4</sup>	$h_{min,deck}$	in.	2-1/2	2-1/2			2-1/2			2-1/2		2-1/2	3-1/4	
Pullout strength, uncracked concrete <sup>5,6</sup>	$N_{p,deck,uncr}$	lb	1,725	1,855	2,625	2,995	1,855	2,750	3,745	4,715	4,415	5,815	3,800	4,795
Pullout strength, cracked concrete <sup>5,6</sup>	$N_{p,deck,cr}$	lb	515	1,625	2,295	2,405	1,650	2,135	3,275	3,340	3,930	4,395	3,325	3,730
Pullout strength, seismic <sup>5,7</sup>	$N_{p,deck,eq}$	lb	515	1,625	2,295	2,405	1,650	2,135	3,275	3,340	3,930	4,395	3,325	3,730
Steel strength in shear <sup>8</sup>	$V_{sa,deck}$	lb	1,630	1,355	2,120	2,120	1,790	2,260	3,555	4,345	3,815	6,150	4,085	7,865
Steel strength in shear, seismic <sup>7</sup>	$V_{sa,deck,eq}$	lb	1,630	1,355	2,120	2,120	1,790	2,260	3,555	4,345	3,815	6,150	4,085	7,865
Loads According to Figure 5B														
Minimum concrete thickness over upper flute <sup>4</sup>	$h_{min,deck}$	in.	2-1/2	2-1/2			2-1/2			2-1/2		2-1/2	3-1/4	
Pullout strength, uncracked concrete <sup>5,6</sup>	$N_{p,deck,uncr}$	lb	1,725	1,855	2,625	2,995	1,855	2,750	3,745	4,715	4,415	5,815	3,800	4,795
Pullout strength, cracked concrete <sup>5,6</sup>	$N_{p,deck,cr}$	lb	515	1,625	2,295	2,405	1,650	2,135	3,275	3,340	3,930	4,395	3,325	3,730
Pullout strength, seismic <sup>5,7</sup>	$N_{p,deck,eq}$	lb	515	1,625	2,295	2,405	1,650	2,135	3,275	3,340	3,930	4,395	3,325	3,730
Steel strength in shear <sup>8</sup>	$V_{sa,deck}$	lb	1,630	1,355	2,120	2,120	1,790	2,260	3,285	4,235	3,815	4,650	4,085	7,865
Steel strength in shear, seismic <sup>7</sup>	$V_{sa,deck,eq}$	lb	1,630	1,355	2,120	2,120	1,790	2,260	3,285	4,235	3,815	4,650	4,085	7,865
Loads According to Figure 5C														
Minimum concrete thickness over upper flute <sup>4</sup>	$h_{min,deck}$	in.	2-1/4	2-1/4		N/A	2-1/4		N/A	3-1/4	3-1/4	N/A	N/A	N/A
Pullout strength, uncracked concrete <sup>5,6</sup>	$N_{p,deck,uncr}$	lb	1,380	990	2,485	N/A	1,815	1,900	N/A	2,665	2,960	N/A	N/A	N/A
Pullout strength, cracked concrete <sup>5,6</sup>	$N_{p,deck,cr}$	lb	410	870	2,130	N/A	1,480	1,480	N/A	1,890	2,635	N/A	N/A	N/A
Pullout strength, seismic <sup>5,7</sup>	$N_{p,deck,eq}$	lb	410	870	2,130	N/A	1,480	1,480	N/A	1,890	2,635	N/A	N/A	N/A
Steel strength in shear <sup>8</sup>	$V_{sa,deck}$	lb	1,125	2,370	2,505	N/A	2,680	3,175	N/A	3,465	4,085	N/A	N/A	N/A
Steel strength in shear, seismic <sup>7</sup>	$V_{sa,deck,eq}$	lb	1,125	2,370	2,505	N/A	2,680	3,175	N/A	3,465	4,085	N/A	N/A	N/A

<sup>1</sup> Installations must comply with Section 4.1.9 and Section 4.3 and Figure 5A, Figure 5B and Figure 5C of this report.

<sup>2</sup> The values for  $\phi_{p,N}$  in tension can be found in Table 4 of this report. The values for  $\phi_{sa,V}$  in shear can be found in Table 6 of this report.

<sup>3</sup> Evaluation of concrete breakout capacity in accordance with ACI 318-19 17.6.2, 17.7.2 and 17.7.3, ACI 318-14 17.4.2, 17.5.2 and 17.5.3 or ACI 318-11 D.5.2, D.6.2, and D.6.3, as applicable, is not required for anchors installed in the deck soffit.

<sup>4</sup> Minimum concrete thickness refers to concrete thickness above upper flute. See Figures 5A to 5C.

<sup>5</sup> Characteristic pullout resistance for concrete compressive strengths greater than 3,000 psi (20.7 MPa) may be increased by multiplying the value in the table by  $(f'_c / 3000)^{0.5}$  for psi or  $(f'_c / 20.7)^{0.5}$  for MPa.

<sup>6</sup> The values listed must be used in accordance with Section 4.1.4 of this report.

<sup>7</sup> The values listed must be used in accordance with Sections 4.1.4 and 4.1.8 of this report.

<sup>8</sup> The values listed must be used in accordance with Section 4.1.5 of this report.

<sup>9</sup> For core drill installations, with 3/4-inch diameter anchors installed at 3 3/4 inches (95 mm) effective embedment, apply a reduction factor of 0.89 to the design tension strength of anchors installed in uncracked concrete.

**TABLE 9—HILTI KB-TZ2 CARBON STEEL ANCHORS SETTING INFORMATION FOR INSTALLATION ON THE TOP OF CONCRETE-FILLED PROFILE STEEL DECK ASSEMBLIES ACCORDING TO FIGURE 5D<sup>1,2,3</sup>**


Design Information	Symbol	Units	Nominal anchor diameter (in.)			
			1/4	3/8	1/2	
Effective Embedment Depth	$h_{ef}$	in. (mm)	1-1/2 (38)	1-1/2 (38)	2 (51)	2 (51)
Nominal Embedment Depth	$h_{nom}$	in. (mm)	1-3/4 (44)	1-7/8 (48)	2-1/2 (64)	2-1/2 (64)
Minimum Hole Depth	$h_o$	in. (mm)	2 (51)	2 (51)	2-1/2 (64)	2-3/4 (70)
Minimum Concrete Thickness <sup>4</sup>	$h_{min,deck}$	in. (mm)	2-1/2 (64)	2-1/2 (64)	2-1/2 (64)	3-1/4 (83)
Critical Edge Distance	$c_{ac, deck, top}$	in. (mm)	5 (127)	8 (204)	4-1/2 (114)	6 (153)
Minimum Edge Distance	$c_{min, deck, top}$	in. (mm)	3 (76)	16 (408)		7-1/2 (191)
Minimum Spacing	$s_{min, deck, top}$	in. (mm)	3 (76)	8 (204)		9 (229)
Required Installation Torque	$T_{inst}$	ft-lb (Nm)	4 (5)	30 (41)		50 (68)

<sup>1</sup> Installations must comply with Section 4.1.10 and Section 4.3 and Figure 5D of this report.


<sup>2</sup> Design capacity shall be based on calculations according to values in Tables 4 and 6 of this report.

<sup>3</sup> Applicable for  $h_{min,deck} < 4$  inches (102 mm). For  $h_{min,deck} \geq 4$  inches (102 mm), use setting information in Tables 1 and 3 of this report.

<sup>4</sup> Minimum concrete thickness refers to concrete thickness above the upper flute. See Figure 5D.

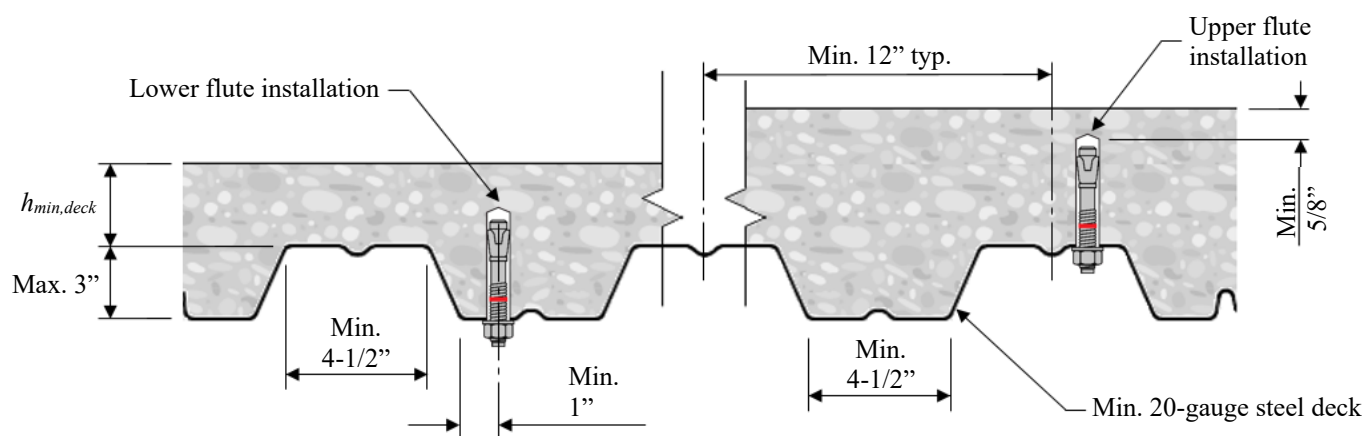

**FIGURE 5A—KB-TZ2 IN THE SOFFIT OF CONCRETE FILLED PROFILE STEEL DECK ASSEMBLIES – W DECK**

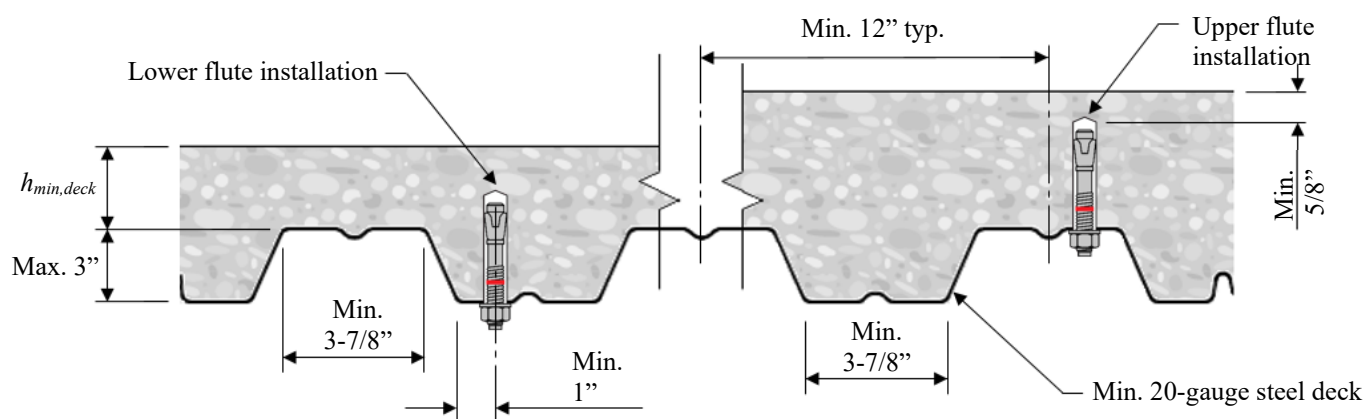

**FIGURE 5B—KB-TZ2 IN THE SOFFIT OF CONCRETE FILLED PROFILE STEEL DECK ASSEMBLIES – W DECK**



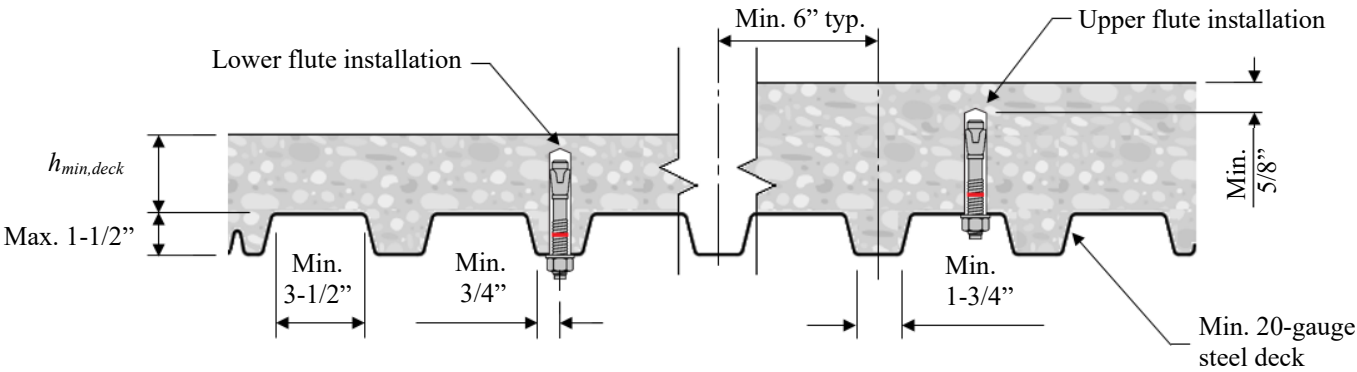


FIGURE 5C—KB-TZ2 IN THE SOFFIT OF CONCRETE FILLED PROFILE STEEL DECK ASSEMBLIES – B DECK

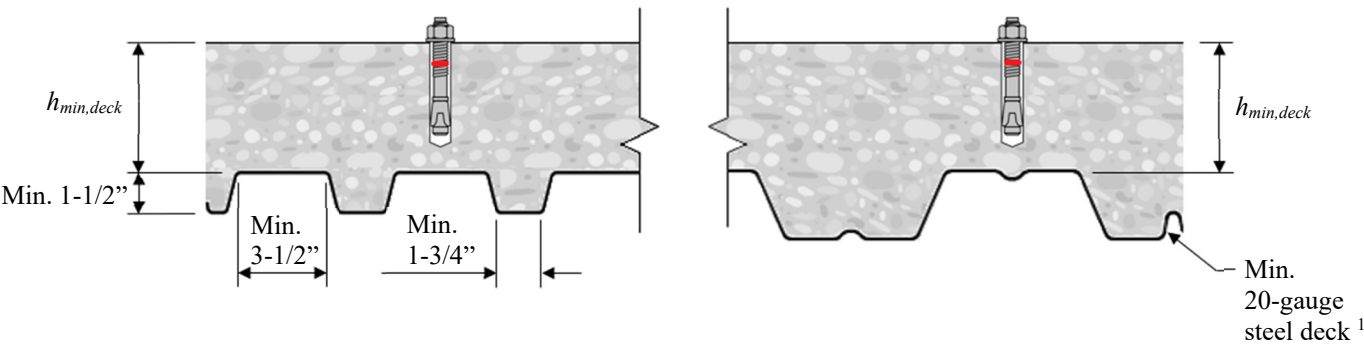


FIGURE 5D—KB-TZ2 IN THE TOP OF CONCRETE FILLED PROFILE STEEL DECK ASSEMBLIES

<sup>1</sup> 1 1/2 inches (38 mm) B-deck as a minimum profile size. Other deck profiles meeting the B-deck minimum dimensions are also permitted.







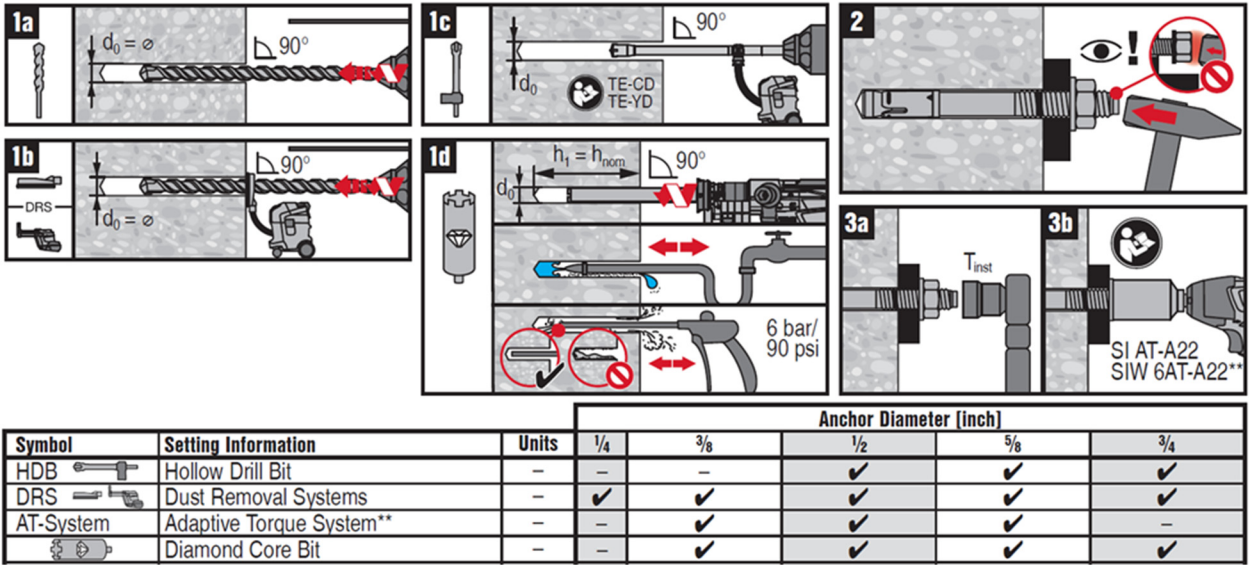
Hilti SafeSet™ System with Hollow Drill Bit	Hilti Dust Removal Systems	Core Drill Systems
  Hilti TE-CD or TE-YD Hollow Carbide Drill Bit, with    Hilti Vacuum (per section 4.3)	  Hilti Rotary Hammer Drill with DRS (Dust Removal System) Module, or    Hilti TE DRS-D Dust Removal System with Hilti Vacuum	  Handheld Hilti DD 30 Core Drill, with    SPX-T Hilti Core Bits (per Section 4.3)

FIGURE 6—HILTI SYSTEM COMPONENTS



# ICC-ES Evaluation Report

# ESR-4266 LABC and LARC Supplement

Issued December 2020

Revised March 2021

*This report is subject to renewal December 2021.*

[www.icc-es.org](http://www.icc-es.org) | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 03 00 00—CONCRETE**

**Section: 03 16 00—Concrete Anchors**

**DIVISION: 05 00 00—METALS**

**Section: 05 05 19—Post-Installed Concrete Anchors**

## REPORT HOLDER:

HILTI, INC.

## EVALUATION SUBJECT:

**HILTI KWIK BOLT TZ2 CARBON AND STAINLESS STEEL ANCHORS IN CRACKED AND UNCRACKED CONCRETE**

## 1.0 REPORT PURPOSE AND SCOPE

### Purpose:

The purpose of this evaluation report supplement is to indicate that the Kwik Bolt TZ2 (KB-TZ2) carbon and stainless steel anchors in cracked and uncracked concrete, described in ICC-ES evaluation report [ESR-4266](#), have also been evaluated for compliance with the codes noted below as adopted by the Los Angeles Department of Building and Safety (LADBS).

### Applicable code editions:

- 2020 *City of Los Angeles Building Code* (LABC)
- 2020 *City of Los Angeles Residential Code* (LARC)

## 2.0 CONCLUSIONS

The Kwik Bolt TZ2 (KB-TZ2) carbon and stainless steel anchors in cracked and uncracked concrete, described in Sections 2.0 through 7.0 of the evaluation report [ESR-4266](#), comply with LABC Chapter 19, and LARC, and are subject to the conditions of use described in this supplement.

## 3.0 CONDITIONS OF USE

The Kwik Bolt TZ2 (KB-TZ2) carbon and stainless steel anchors in cracked and uncracked concrete described in this evaluation report supplement must comply with all of the following conditions:

- All applicable sections in the evaluation report [ESR-4266](#).
- The design, installation, conditions of use and labeling of the Kwik Bolt TZ2 (KB-TZ2) anchors are in accordance with the 2018 *International Building Code*® (2018 IBC) provisions noted in the evaluation report [ESR-4266](#).
- The design, installation and inspection are in accordance with additional requirements of LABC Chapters 16 and 17, as applicable.
- Under the LARC, an engineered design in accordance with LARC Section R301.1.3 must be submitted.
- The allowable and strength design values listed in the evaluation report and tables are for the connection of the anchors to concrete. The connection between the anchors and the connected members shall be checked for capacity (which may govern).
- For use in wall anchorage assemblies to flexible diaphragm applications, anchors shall be designed per the requirements of City of Los Angeles Information Bulletin P/BC 2020-071.

This supplement expires concurrently with the evaluation report, issued December 2020 and revised March 2021.

# ICC-ES Evaluation Report

# ESR-4266 FBC Supplement

Issued December 2020

Revised March 2021

This report is subject to renewal December 2021.

[www.icc-es.org](http://www.icc-es.org) | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 03 00 00—CONCRETE**

**Section: 03 16 00—Concrete Anchors**

**DIVISION: 05 00 00—METALS**

**Section: 05 05 19—Post-Installed Concrete Anchors**

## REPORT HOLDER:

HILTI, INC.

## EVALUATION SUBJECT:

**HILTI KWIK BOLT TZ2 CARBON AND STAINLESS STEEL ANCHORS IN CRACKED AND UNCRACKED CONCRETE**

## 1.0 REPORT PURPOSE AND SCOPE

### Purpose:

The purpose of this evaluation report supplement is to indicate that the Kwik Bolt TZ2 (KB-TZ2) carbon and stainless steel anchors in cracked and uncracked concrete, described in ICC-ES evaluation report ESR-4266, have also been evaluated for compliance with the codes noted below.

### Applicable code editions:

- 2020 Florida Building Code—Building
- 2020 Florida Building Code—Residential

## 2.0 CONCLUSIONS

The Kwik Bolt TZ2 (KB-TZ2) carbon and stainless steel anchors in cracked and uncracked concrete, described in Sections 2.0 through 7.0 of the evaluation report ESR-4266, comply with the *Florida Building Code—Building* and the *Florida Building Code—Residential*, provided the design requirements are determined in accordance with the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable. The installation requirements noted in the ICC-ES evaluation report ESR-4266 for the 2018 *International Building Code*® meet the requirements of the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable.

Use of the Kwik Bolt TZ2 (KB-TZ2) carbon and stainless steel anchors in cracked and uncracked concrete have also been found to be in compliance with the High-Velocity Hurricane Zone provisions of the *Florida Building Code—Building* and the *Florida Building Code—Residential*, with the following conditions:

- a) For anchorage to wood members, the connection subject to uplift, must be designed for no less than 700 pounds (3114 N).
- b) For connection to aluminum members, all expansion anchors must be installed no less than 3 inches from the edge of concrete slab and/or footings. All expansion anchors shall develop an ultimate withdrawal resisting force equal to four times the imposed load, with no stress increase for duration of load.

For products falling under Florida Rule 61G20-3, verification that the report holder's quality assurance program is audited by a quality assurance entity approved by the Florida Building Commission for the type of inspections being conducted is the responsibility of an approved validation entity (or the code official, when the report holder does not possess an approval by the Commission).

This supplement expires concurrently with the evaluation report, issued December 2020 and revised March 2021.