




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. C-AJ-8336


CAJ 8336

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings -2 Hr (See Item 1)	F Rating -2 Hr
T Rating -0 Hr	FT Rating -0 Hr
	FH Rating -2 Hr
	FTH Rating - 0 Hr

TOP VIEW

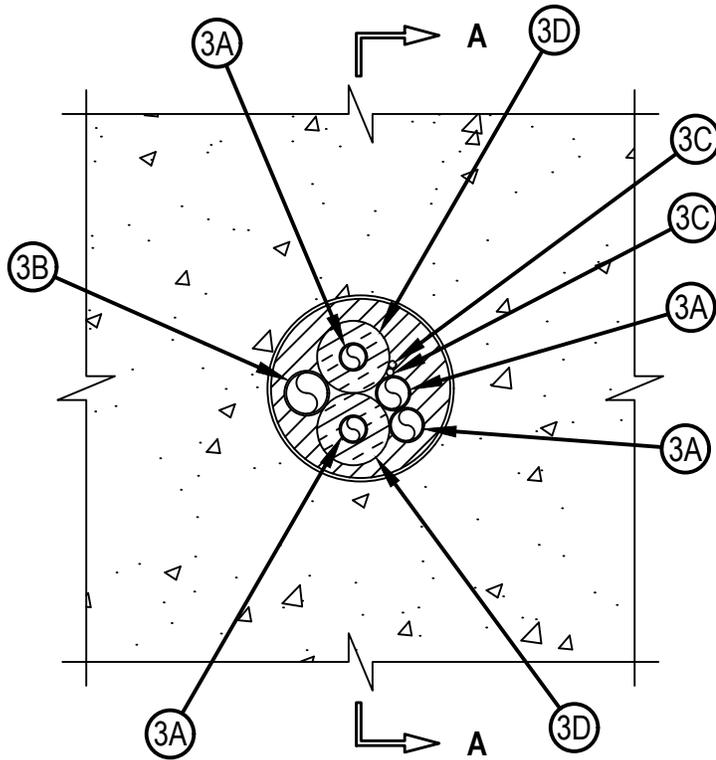

SECTION A-A

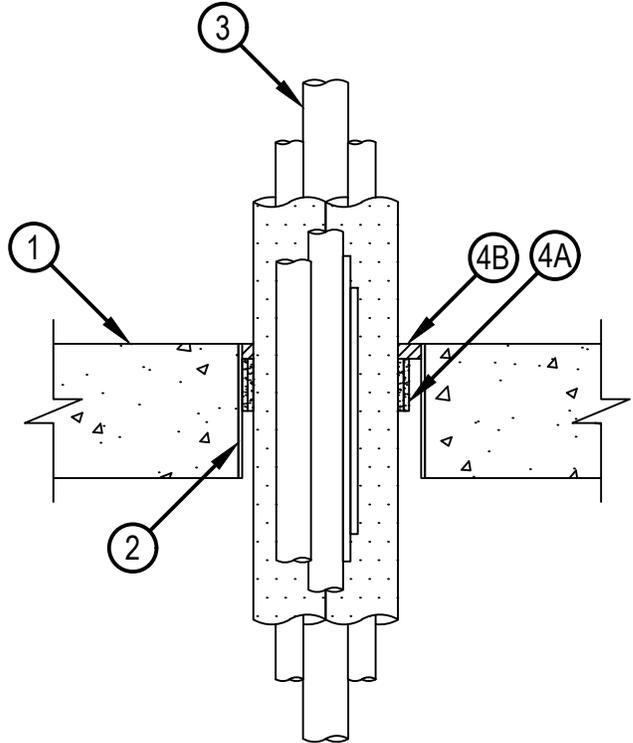

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
March 17, 2026

1. Floor or Wall Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600 - 2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Max diam of opening 5 in. (127 mm).
See Concrete Blocks (CAZT) category in Fire Resistance Directory for names of manufacturers.
2. Metallic Sleeve — (Optional) — Nom 5 in. (127 mm) diam (or smaller) Schedule 10 (or heavier) steel sleeve cast or grouted into floor or wall assembly, flush with both surfaces of floor or wall.
3. Through-Penetrants — Pipes, conduits, tubing or cables to be bundled within opening such that the aggregate cross-sectional area of penetrants in opening to be max 66 percent of the cross-sectional area of the opening in floor or wall. The space between the penetrants and between the penetrants and the periphery of the opening shall be min 3/8 in. (10 mm) to max 1-1/2 in. (38 mm). Penetrants to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of penetrants may be used:
 - A. Metallic Penetrants — The following types and sizes of metallic pipes, conduits or tubing may be used:
 - I. Steel Pipe — Nom 3/4 in. (19 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe
 - II. Iron Pipe — Nom 3/4 in. (19 mm) diam (or smaller) cast or ductile iron pipe.
 - III. Conduit — Nom 3/4 in. (19 mm) diam (or smaller) steel electrical metallic tubing (EMT) or nom 1 in. diam (or smaller) rigid steel conduit.
 - IV. Copper Tubing — Nom 3/4 in. (19 mm) diam (or smaller) Type L (or heavier) copper tubing.
 - V. Copper Pipe — Nom 3/4 in. (19 mm) diam (or smaller) Regular (or heavier) copper pipe.
 - B. Nonmetallic Penetrants — The following types and sizes of nonmetallic pipes, conduits, or tubing may be used:
 - I. Polyvinyl Chloride (PVC) Pipe — Nom 1-1/4 in. (32 mm) diam (or smaller) Schedule 40 solid or cellular core PVC pipe for use in vented (drain, waste or vent) or closed (process or supply) piping systems.
 - II. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 1-1/4 in. (32 mm) diam (or smaller) SDR13.5 CPVC pipe for use in closed (process or supply) piping systems.
 - III. Rigid Nonmetallic Conduit+ — Nom 1-1/4 in. (32 mm) diam (or smaller) Schedule 40 PVC conduit installed in accordance with the National Electrical Code (NFPA 70).
 - C. Cables — Max 4 pair No. 18 AWG (or smaller) copper conductor thermostat cable with PVC jacket and insulation. Max one cable per opening.
 - D. Insulated Metallic Pipe Assemblies* — (BONH) - A max of two nom 3/4 in. diam (19 mm) or smaller copper pipe or tube provided with nom 3/4 in. (19 mm) thick (or less) low density polyethylene (LDPE) flexible foam. Insulated penetrant and non-insulated penetrants to be tightly bundled together.
PDM US LCC - GelBlack PREINSULATED COPPER ROLL
4. Firestop System — The details of the firestop system shall be as follows:
 - A. Fill, Void or Cavity Material* — Wrap Strip — Nom 3/16 in. (5 mm) thick by 1-3/4 in. (44 mm) wide intumescent wrap strip continuously wrapped around the through penetrant bundle twice with the ends held in place with masking tape. In floors, bottom edge of wrap strip to be recessed 2-1/4 in. (57 mm) from bottom surface of concrete floor. In walls, the wrap strip shall be installed on both surfaces such that the exposed edges of the wrap strip are recessed a max 1/2 in. (13 mm) from each side of the wall.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP648-E W45/1-3/4" Wrap Strip
 - B. Fill, Void or Cavity Materials* - Sealant — Min 1/2 in. (13 mm) thickness of sealant applied within the annulus, flush with top surface of floor or with both surfaces of wall. Additional sealant to be applied within interstices of through penetrant bundle and wrap strip to the max extent possible.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC —FS-ONE MAX Intumescent Sealant

+Bearing the UL Listing Mark

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
March 17, 2026