




Classified by  
Underwriters Laboratories, Inc.  
to UL 1479 and CAN/ULC-S115

# System No. W-J-0006

F Ratings - 1 and 2 Hr (See Items 1 and 2)

T Ratings - 1 and 2 Hr (See Item 2)

WJ 0006

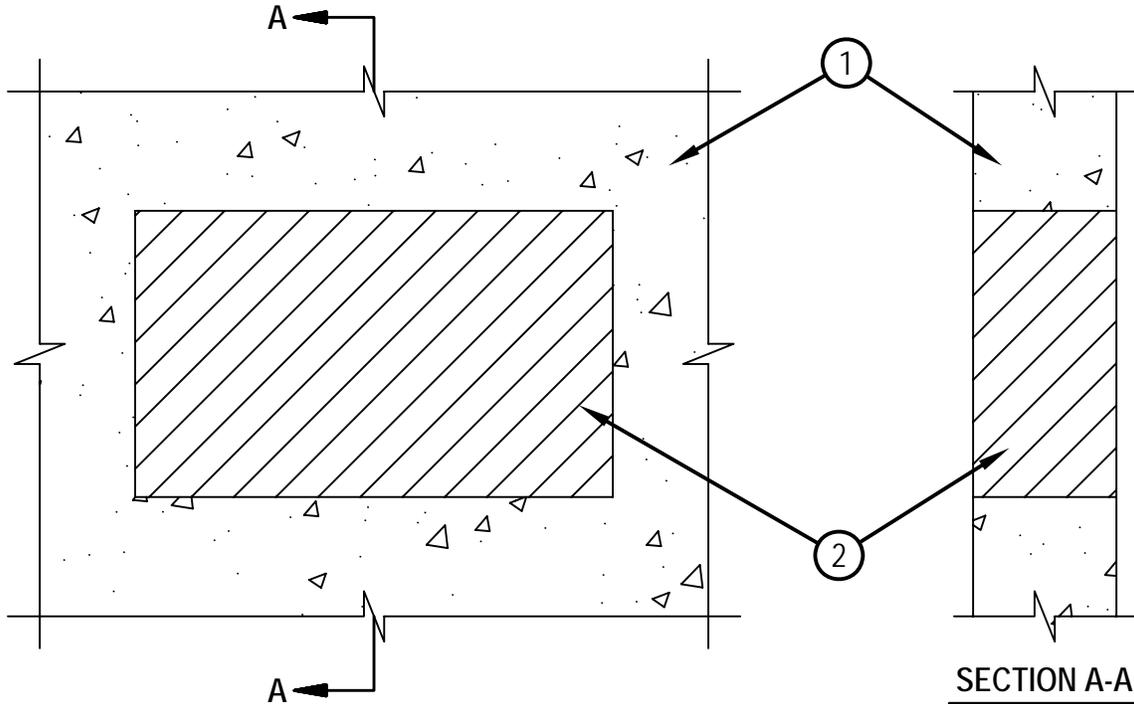

1. Wall Assembly — Min 4-3/4 in. and 6 in. thick reinforced lightweight or normal weight (100-150pcf) concrete for 1 and 2 hr fire rated walls, respectively. Wall may also be constructed of any solid or filled UL Classified Concrete Blocks\* Max area of opening is 450 in.2 with max dimension of 30 in.

See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. Fill, Void or Cavity Material\* — Foam Fill material applied within annulus flush with one surface of the wall. Min fill material thickness for 1 hr F and T Ratings is 4-3/4 in. Min fill material thickness for 2 hr F and T Ratings is 6 in.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 620 Fire Foam

\*Bearing the UL Classification Mark



**Hilti Firestop Systems**

Reproduced by HILTI, Inc. Courtesy of  
Underwriters Laboratories, Inc.

July 24, 2002