




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. W-J-7085

F Rating - 2 Hr
T Rating - 1/2 Hr

WJ 7085

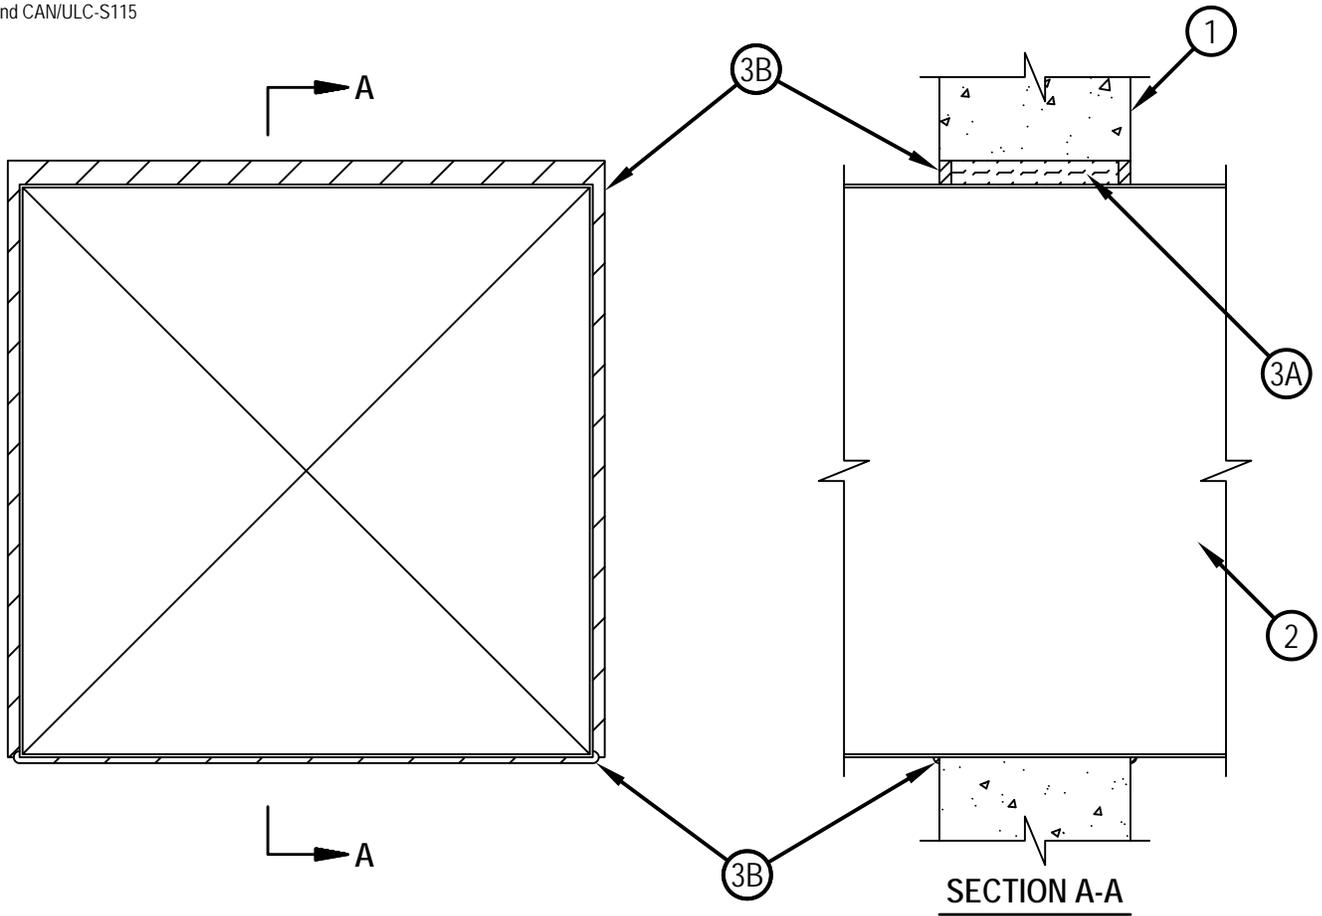

1. Wall Assembly — Min 6 in. (152 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Max size of opening is 625 sq in. (4032 cm²) with a max dimension of 25 in. (635 mm).

See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. Steel Duct — Nom. 24 in. by 24 in. (610 by 610 mm) (or smaller) No. 24 gauge (or heavier) galv. steel duct to be installed within the firestop system. An annular space of min 1/2 in. (13 mm) to max 1 in. (25 mm) is required within the firestop system. As an option, the min annular space at the bottom of the duct may be 0 in. (point contact). Steel duct to be rigidly supported on both sides of wall assembly

3. Firestop System — The firestop system shall consist of the following:

A. Packing Material — Min 5 in. (127 mm) thickness of min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from both surfaces of wall to accommodate the required thickness of fill material.

B. Fill Void or Cavity Materials* - Sealant — Min 1/2 in. (13 mm) thickness of sealant applied within annulus, flush with both surfaces of wall assembly. Min 1/4 in. (6 mm) diam bead of sealant shall be applied at the duct/concrete interface at any point contact location, on both surfaces of wall assembly.

HILTI CONSTRUCTION CHEMICALS, DIV OF
HILTI INC — CP 606 Sealant

*Bearing the UL Classification Mark



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
November 29, 2005