





Classified by Underwriters Laboratories, Inc. to UL 1479 and CAN/ULC-S115


System No. W-L-8019

F Rating -- 1 and 2 Hr (See Items 1, 3 and 4)
T Rating -- 0, 1/2, 1, 1-1/2 and 2 Hr (See Item 2)

WL 8019

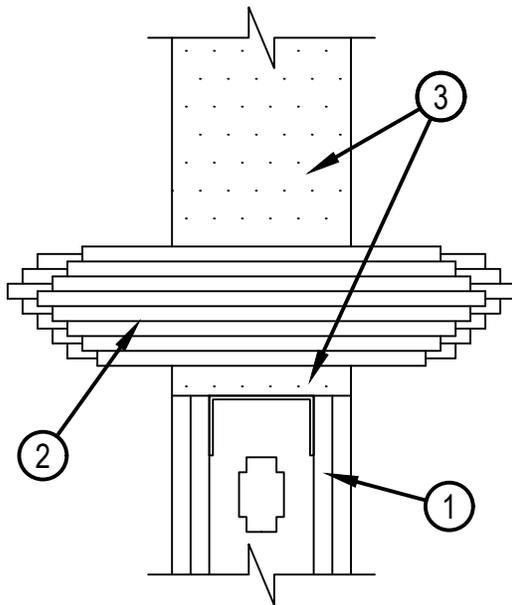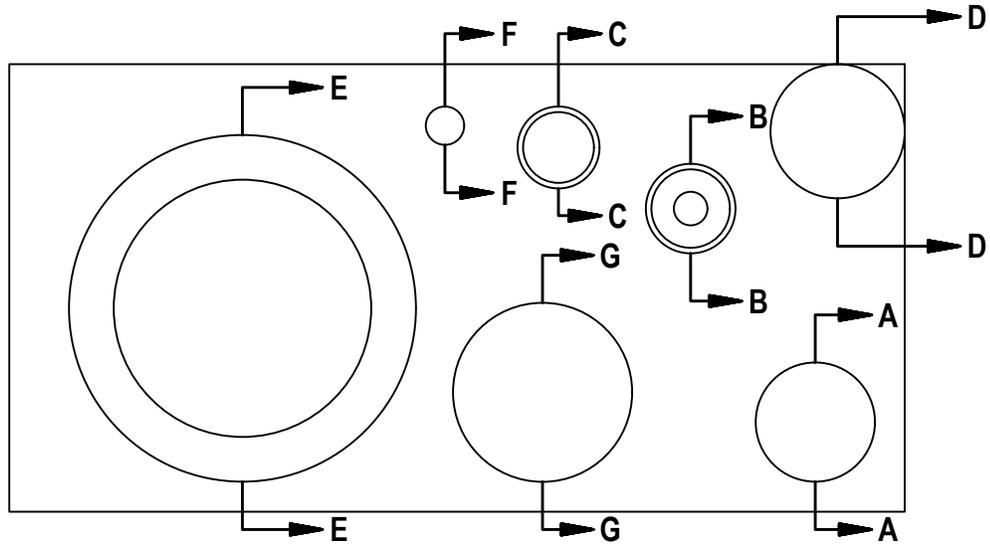

FIRESTOP CONFIGURATION A

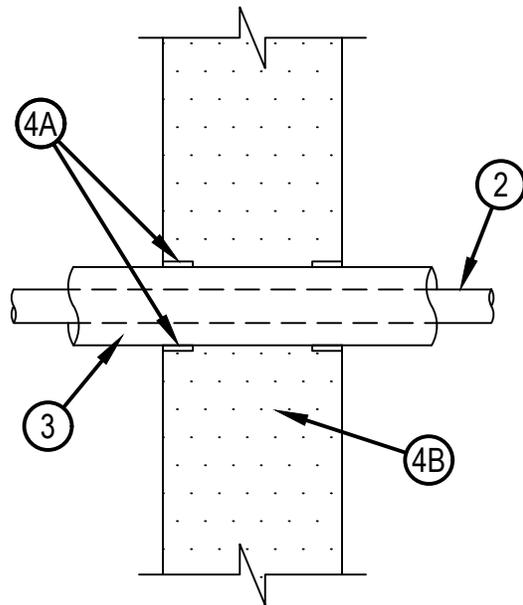

FIRESTOP CONFIGURATION B



Hilti Firestop Systems


Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. April 22, 2005




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. W-L-8019


F Rating -- 1 and 2 Hr (See Items 1, 3 and 4)
T Rating -- 0, 1/2, 1, 1-1/2 and 2 Hr (See Item 2)

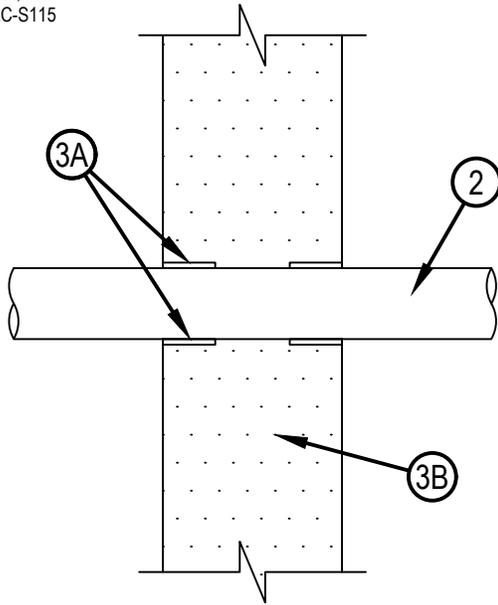


FIRESTOP CONFIGURATION C

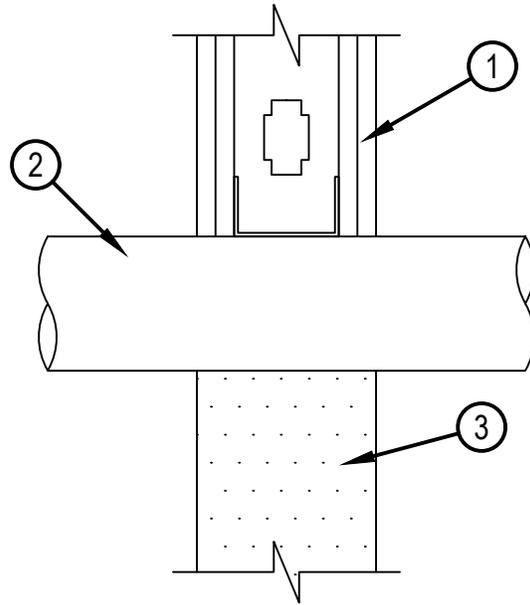

FIRESTOP CONFIGURATION D

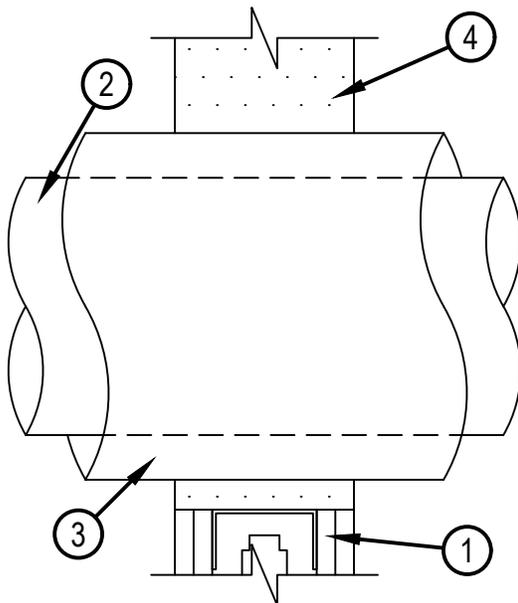

FIRESTOP CONFIGURATION E

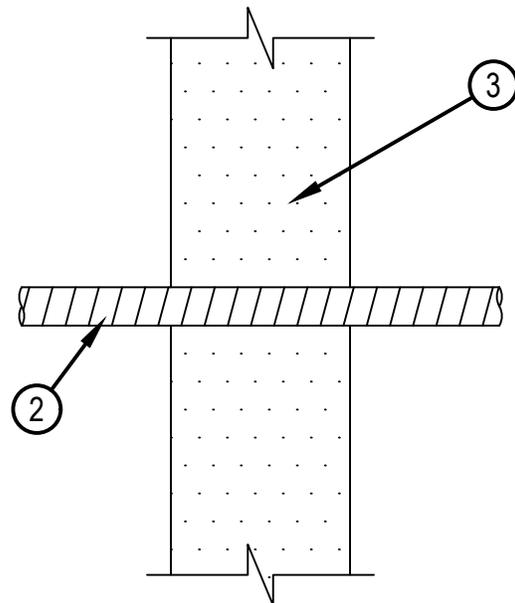

FIRESTOP CONFIGURATION F



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
April 22, 2005




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. W-L-8019

F Rating -- 1 and 2 Hr (See Items 1, 3 and 4)
T Rating -- 0, 1/2, 1, 1-1/2 and 2 Hr (See Item 2)

WL 8019

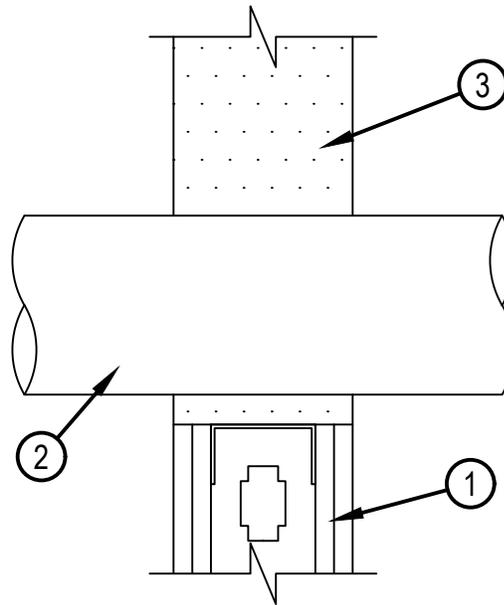

FIRESTOP CONFIGURATION G

1. Wall Assembly -- The 1 or 2 hr fire-rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner described in the individual U400 Series Wall or Partition Design in the UL Fire Resistance Directory and shall include the following construction features:

- A. Studs -- Steel studs 3-1/2 in. deep, fabricated from 25 MSG galv steel, spaced max 24 in. OC.
- B. Gypsum Board* -- The gypsum board type, number of layers, fastener type and sheet orientation shall be as specified in the individual Wall and Partition Design. Max area of opening is 450 sq in with max dimension of 30 in.

The hourly F Rating of the firestop system is equal to the hourly fire rating of the wall assembly in which it is installed.

2. Through Penetrants -- A max of seven firestop configurations may be installed within the opening. The space between firestop configurations. Unless otherwise indicated, the space between firestop configurations and periphery of opening shall be min 3/8 in. Pipe, conduit, tubing or cables to be rigidly supported on both sides of floor or wall assembly. The T Rating of the system is dependent on the firestop configurations, as shown in the table below. Any combination of the following firestop configurations detailed herein may be used:

Firestop Configuration	1 Hr F Rating	2 Hr F Rating
	T Rating Hr	T Rating Hr
A	0	1/2
B	1	1-1/2
C	1/2	1
D	0	0
E	1	2
F	0	0
G	0	0



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
April 22, 2005



Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. W-L-8019

F Rating -- 1 and 2 Hr (See Items 1, 3 and 4)
T Rating -- 0, 1/2, 1, 1-1/2 and 2 Hr (See Item 2)

WL 8019

2. Cables -- Max 4 in. diam tightly bundled cable. The min space between adjacent penetrants shall be 4 in. Cable bundle may be any combination of the following types and sizes of cables:
 - G. Max 25 pair No. 24 AWG copper telephone cable with polyvinyl chloride (PVC) insulation and jacket materials.
 - H. Max 7/C No. 12 AWG cable with PVC insulation and jacket materials.
 - I. Multiple fiber optical communication cables with PVC jacket material and having a max outside diameter of 3/8 in.
 - J. Max 3/C No. 12 AWG steel clad cables with PVC insulation and jacket materials.
 - K. Max 3/C No. 8 AWG cable with ground with PVC insulation and jacket materials.
 - L. Max RG 59 coaxial cables with PVC insulation and jacket materials.
3. Fill, Void or Cavity Material* - Foam -- Fill material applied within annulus flush with both surfaces of the wall. Min fill material thickness for 1 hr F Rating is 4-3/4 in. Min fill material thickness for 2 hr F Rating is 6 in.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 620 Fire Foam

Firestop Configuration B

2. Copper Tubing or Pipe -- Nom 1 in. diam (or smaller) Type L copper tube or nom 1 in diam (or smaller) Regular (or heavier) copper pipe. Min space between adjacent penetrants shall be 3 in.
3. Tube Insulation - Plastics+ -- Nom 3/4 in. thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing. The min space between adjacent penetrants shall be 1-1/2 in.
See Plastics+ (QMFZ2) category in the Plastics Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5VA may be used.
4. Firestop System -- The firestop system shall consist of the following:
 - A. Fill, Void or Cavity Material* - Wrap Strip -- Nom 3/16 in thick by 1 in wide intumescent wrap strip. The wrap strip is continuously wrapped around the outer circumference of the pipe covering one time and held in place with tape. Wrap strips are installed flush with each side of wall.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 648-E W45/1-3/4 Wrap Strip
 - B. Fill, Void or Cavity Material* - Foam -- Fill material applied within annulus flush with both surfaces of the wall. Min fill material thickness for 1 hr F Rating is 4-3/4 in. Min fill material thickness for 2 hr F Rating is 6 in.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 620 Fire Foam

Firestop Configuration C

2. Polyvinyl Chloride (PVC) Pipe -- Nom 2 in. diam (or smaller) Schedule 40 solid or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system. The min space between non-metallic penetrants shall be 1 in. The min space between metallic penetrants shall be 3-1/2 in.
3. Firestop System -- The firestop shall consist of the following:
 - A. Fill, Void or Cavity Material* - Wrap Strip -- Nom 3/16 in thick by 1 in wide intumescent wrap strip. The wrap strip is continuously wrapped around the outer circumference of the pipe covering one time and held in place with tape. Wrap strips are installed flush with each side of wall.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 648-E W25/1" Wrap Strip
 - B. Fill, Void or Cavity Material* - Foam -- Fill material applied within annulus flush with both surfaces of the wall. Min fill material thickness for 1 hr F Rating is 4-3/4 in. Min fill material thickness for 2 hr F Rating is 6 in.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 620 Fire Foam



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
April 22, 2005



Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. W-L-8019

F Rating -- 1 and 2 Hr (See Items 1, 3 and 4)
T Rating -- 0, 1/2, 1, 1-1/2 and 2 Hr (See Item 2)

WL 8019

Firestop Configuration D

2. Through Penetrant -- One metallic pipe, conduit or tube to be installed either concentrically or eccentrically within the firestop system. The min annular space between the pipe, conduit or tube and the periphery of the opening shall be min. 0 in. (point contact). The annular space between adjacent penetrants shall be min 3-1/2 in. The following types and sizes of metallic pipes, conduits or tubes may be used:

- Steel Pipe -- Nom 4 in. diam (or smaller) Schedul 10 (or heavier) steel pipe.
- Iron Pipe -- Nom 4 in. diam (or smaller) cast or ductile iron pipe.
- Conduit -- Nom 4 in. diam (or smaller) rigid steel conduit.
- Conduit -- Nom 4 in. diam (or smaller) steel electrical metallic conduit.
- Copper Tubing -- Nom 4 in. diam (or smaller) Type L (or heavier) copper tubing.
- Copper Pipe -- Nom 4 in. diam (or smaller) Regular (or heavier) copper pipe.

3. Fill, Void or Cavity Material* - Foam -- Fill material applied within annulus flush with both surfaces of the wall. Min fill material thickness for 1 hr F Rating is 4-3/4 in. Min fill material thickness for 2 hr F Rating is 6 in.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 620 Fire Foam

Firestop Configuration E

2. Steel Pipe -- Nom 8 in. diam (or smaller) Schedule 40 (or heavier) steel pipe.

3. Pipe Covering Materials* -- Nom 1-1/2 in. thick hollow cylindrical heavy density (min 3.5 pcf) glass fiber units jacketed on the outside with an all-service jacket. Longitudinal joints sealed with metal fasteners or factory-applied, self-sealing lap tape. Transverse joints secured with metal fasteners of with butt tape supplied with product. The min space between adjacent penetrants shall be 2 in.

See Pipe and Equipment Covering - Materials (BRGU) Category in the Building Materials Directory for names of manufacturers. Any pipe covering meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.

4. Fill, Void or Cavity Material* - Foam -- Fill material applied within annulus flush with both surfaces of the wall. Min fill material thickness for 1 hr F Rating is 4-3/4 in. Min fill material thickness for 2 hr F Rating is 6 in.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 620 Fire Foam

Firestop Configuration F

2. Flexible Conduit -- Nom 1 in. diam (or smaller) flexible steel conduit. The min space between adjacent penetrants shall be 3-1/2 in.

3. Fill, Void or Cavity Material* - Foam -- Fill material applied within annulus flush with both surfaces of the wall. Min fill material thickness for 1 hr F Rating is 4-3/4 in. Min fill material thickness for 2 hr F Rating is 6 in.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 620 Fire Foam

Firestop Configuration G

2. Steel Duct -- Nom 6 in. diam (or smaller) No. 28 gauge (or heavier) galve steel duct. The min space between adjacent penetrants shall be 1-1/2 in.

3. Fill, Void or Cavity Material* - Foam -- Fill material applied within annulus flush with both surfaces of the wall. Min fill material thickness for 1 hr F Rating is 4-3/4 in. Min fill material thickness for 2 hr F Rating is 6 in.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CP 620 Fire Foam

*Bearing the UL Classification Mark



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
April 22, 2005